



**MOUR GROUP**  
ENGINEERING + DESIGN

6593 Riverdale St.  
San Diego, CA 92120  
619-727-4800

**Structural Calculations**  
**for**  
**CBKD-136 Series**  
**KDKITSLM1830**



**Prepared for:**

**PROVENT / RRS**

**3847 Wabash Drive**  
**Mira Loma, CA 91725**



**Date: October 1, 2021**

**Project Number: PV2101**


<b>For wood, concrete and steel attachments see Roof Anchorage Detail, Form Nos. CB-60.</b>	<b>STRUCTURALLY CALCULATED KNOCK-DOWN ROOF CURBS FOR YORK UNITS</b>	<b>PROVENT P/N</b>	<b>A</b>	<b>EST. WEIGHT</b>	<b>SEISMIC KIT P/N</b>
		CBKDSLML183008	8"	125 Lbs.	KDKITSLM1830
		CBKDSLML183011	11"	139 Lbs.	<b>Meets seismic requirements for the following codes:</b> CBC 2019 IBC 2018
CBKDSLML183014	14"	154 Lbs.			

Will conform to seismic code requirements for knock-down or pre-assembled application. (Contact factory for assembled version.)


ZJ, ZR 180-300; XP 180-240  
ZF 210-300; ZT 180-276

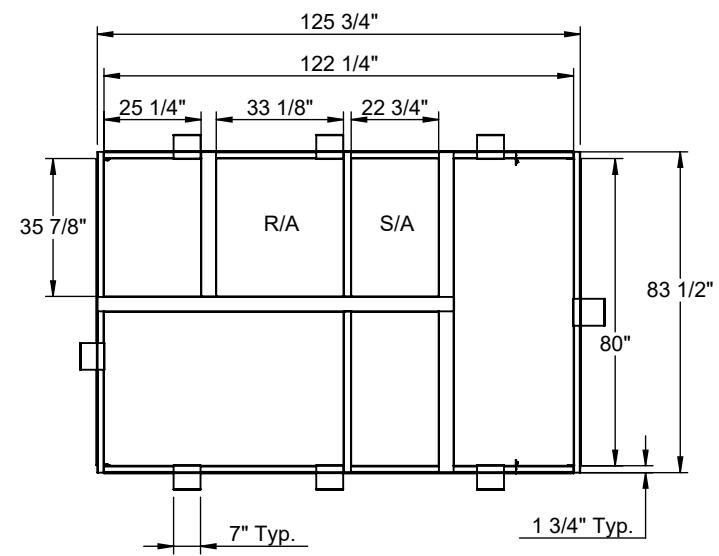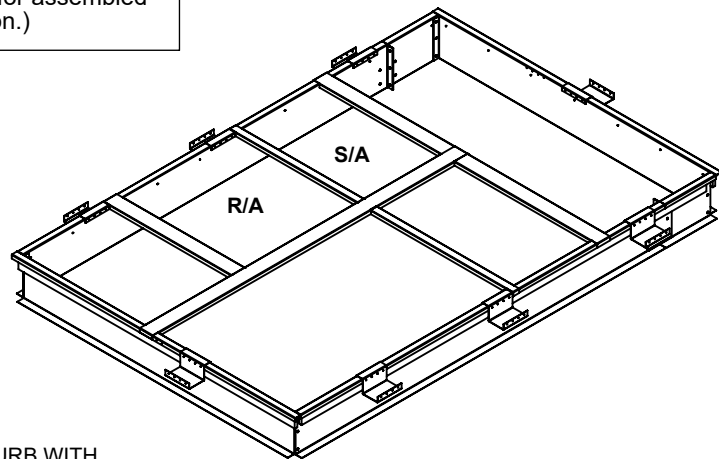


ATTACH TO CURB WITH (3) #10 x 3/4" TEK SCREWS EACH HOLD DOWN

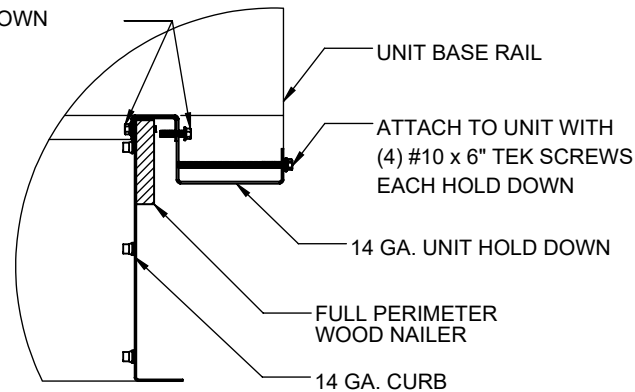

**HOLD DOWN DETAIL**

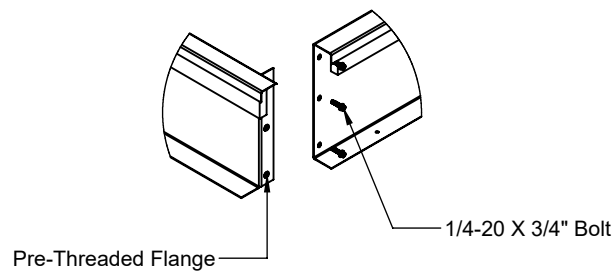


**CROSS SECTION DETAIL**

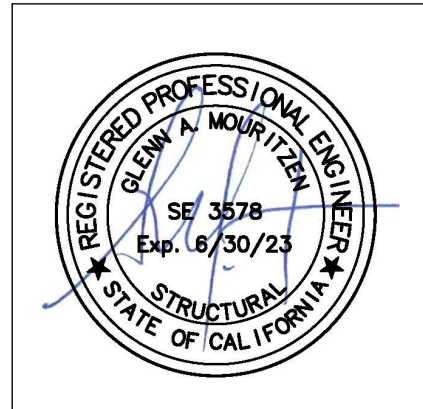

	<b>3847 WABASH DRIVE  MIRA LOMA, CA 91725</b>	<b>SUBMITTED TO:</b> _____ <b>COMPANY:</b> _____ <b>JOB NAME:</b> _____ <b>EQUIPMENT:</b> _____ <b>NOTES:</b> _____	<b>FORM NO:</b> CBKD-136	<b>PART NUMBER:</b> KDKITSLM1830
	<b>PHONE (951) 685-1101  FAX (619) 872-9799</b>	<b>DATE:</b> 9/9/2021	<b>REV:</b> 2	<b>DRAWN BY:</b> ALL

**STEEL ATTACHMENT**

CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 1/2" (OR 5/8" FOR MIL SERIES ONLY) Ø A307 BOLTS ATTACHED TO STEEL ANGLE BELOW DECK AT EACH CONNECTION POINT.

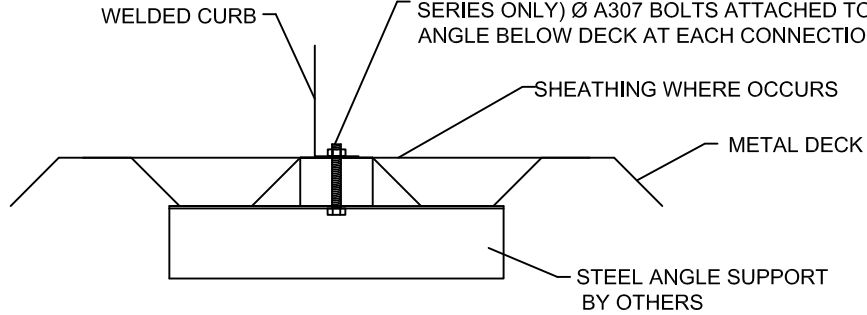

**NO. OF ANCHORAGE BOLTS REQUIRED**


CURB	LONG SIDE	SHORT SIDE
LXS	2 @ 34.5" O.C.	2 @ 19" O.C.
LXL	2 @ 34.5" O.C.	2 @ 29" O.C.
SUN3672	2 @ 60.5" O.C.	2 @ 39" O.C.
PRD3715	2 @ 68.88" O.C.	2 @ 39" O.C.
PRS	2 @ 58.88" O.C.	2 @ 28.69" O.C.
PRL	2 @ 72" O.C.	2 @ 41.5" O.C.
SLU180	3 @ 51.38" O.C.	2 @ 71.5" O.C.
SLM1830	3 @ 56.88" O.C.	3 @ 35.75" O.C.

**ASSUMES:**

CONC SLAB  
f<sub>c</sub>= 4000PSI MINIMUM  
6" MIN THICKNESS  
NORMAL WEIGHT CONCRETE  
OR SAND LIGHT WEIGHT

**CONCRETE ATTACHMENT**

WELDED CURB



CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 3/4" Ø THREADED ROD IN HILTI HIT-HY 200 EPOXY WITH 4" EMBED

**NO. OF ANCHORAGE BOLTS REQUIRED**

CURB	LONG SIDE	SHORT SIDE
LXS	4 @ 11.5" O.C.	3 @ 9.5" O.C.
LXL	4 @ 11.5" O.C.	3 @ 14.5" O.C.
SUN3672	4 @ 20.17" O.C.	3 @ 12.38" O.C.
PRD3715	9 @ 8.61" O.C.	7 @ 6.5" O.C.
PRS	5 @ 14.72" O.C.	4 @ 9.56" O.C.
PRL	6 @ 14.4" O.C.	5 @ 10.38" O.C.
SLU180	8 @ 14.68" O.C.	7 @ 11.92" O.C.
SLM1830	12 @ 10.34" O.C.	10 @ 7.94" O.C.

Meets seismic requirements for the following codes:  
CBC 2019  
IBC 2018


**ROOF ANCHORAGE DETAIL**

CBKD Series	CBWC Series
LXS	LXS
LXL	LXL
SUN3672	SUN3672
PRD3715	PRD3715
PRS	PRS
PRL	PRL
SLU180	SLU180
SLM1830	SLM1830

\* SIX INCHES FROM EACH CORNER EVENLY SPACED.  
\*\* CENTERED.

**WOOD ATTACHMENT**

WELDED CURB



CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 1/4" Ø SIMPSON SDS OR EQUIVALENT SCREWS (3 1/2" MIN. EMBED. INTO WOOD FRAMING)

5/8" Ø LAG SCREW W/MIN. 3.5" EMBED (SGMIN=0.43) (FOR MIL SERIES ONLY)

**NO. OF ANCHORAGE SCREWS REQUIRED**

CURB	LONG SIDE	SHORT SIDE
LXS	4 @ 12.83" O.C.	3 @ 11.5" O.C.
LXL	4 @ 12.83" O.C.	3 @ 16.5" O.C.
SUN3672	4 @ 21.5" O.C.	3 @ 14.38" O.C.
PRD3715	9 @ 9.11" O.C.	8 @ 6.14" O.C.
PRS	4 @ 20.96" O.C.	3 @ 16.34" O.C.
PRL	5 @ 19" O.C.	4 @ 15.17" O.C.
SLU180	9 @ 13.34" O.C.	7 @ 12.58" O.C.
SLM1830	13 @ 9.81" O.C.	12 @ 6.86" O.C.

FOUR INCHES FROM EACH CORNER EVENLY SPACED



3847 WABASH DRIVE  
MIRA LOMA, CA 91725

PHONE (951) 685-1101  
FAX (619) 872-9799

SUBMITTED TO: \_\_\_\_\_  
COMPANY: \_\_\_\_\_  
JOB NAME: \_\_\_\_\_  
EQUIPMENT: \_\_\_\_\_  
NOTES: \_\_\_\_\_

FORM NO:  
CB-60

DATE:  
10/07/2021

REV:  
7

DRAWN BY:  
FMM




Client:	ProVent PV2101	Previous:	PV1806
Description:	CBKD-136 14"	KDKITSLM1830	
Unit:	ZJ,ZR 180-300; ZF 210-300; XP 180-240		

**Curb Information**

Hcurb =	14 in	(Height of curb)
Lcurb =	125.75 in	(Length of curb)
wcurb =	83.5 in	(Width of curb)
WGTcurb =	192 lbs	(Weight of curb)
# Clips long side =	3	
# Clips short side =	1	

**Unit Information**

WGUnit =	3061.3 lbs	(Weight of Unit)
Wtmax =	908 lbs	(Maximum corner weight)
Wtmin =	306 lbs	(Minimum corner weight)
Hunit =	52.625 in	(Height of unit above curb)
Hcm =	26.3125 in	(Height to center of mass)
Lunit =	136.25 in	(Length of unit)
Wunit =	92 in	(Width of unit)

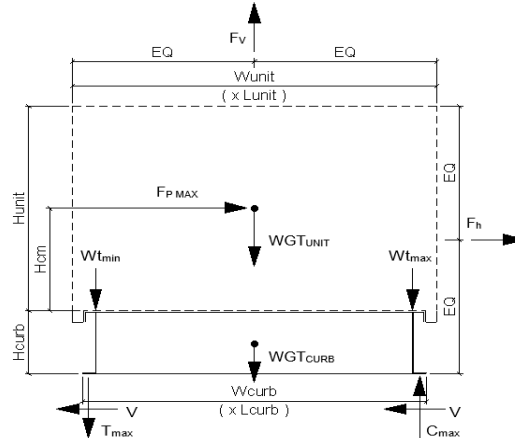

**Seismic Loading - 2018 IBC/2019 CBC**

Ss =	2.85	(Worst case for majority of California)
Fa =	1.2	Default Site Class D
Ip =	1.50	(Importance Factor Category III Building)
Sms =	3.420	(Fa*Ss)
Sds =	2.280	(2/3*Sms)
Fpmax =	1.710 Wp	(0.4*ap*Sds*Ip)*Wp*3/Rp <= 1.6*Sds*Ip*Wp
FpmaxASD =	3664 lbs	(0.7*Fpmax)
	(unit only)	
ap =	2.5	
Rp =	6	
FpmaxASD =	3894 lbs	(unit and curb)

**Wind Loading - 2018 IBC/2019 CBC**

\*\*\* Exposure Category C \*\*\*

Kz =	1.13	(For 60 ft roof height, Exposure C - Table 26.10-1 ASCE 7-16)
Kzt =	1.0	(No topographic effects assumed for rooftop mounted units)
Kd =	0.85	(Directionality factor Table 26.6-1 ASCE 7-16)
V =	115	(Max wind velocity, mph for Cat III & IV bldgs Exp. Cat C)
GCr <sub>(horiz)</sub> =	1.9	(Refer Sect 29.4.1 ASCE 7-16)
GCr <sub>(vert)</sub> =	1.5	(Refer Sect 29.4.1 ASCE 7-16)
qz =	32.5 psf	= 0.00256*Kz*Kzt*Kd*V <sup>2</sup> (Eq. 26.10-1 ASCE 7-16)
F <sub>h ASD trans</sub> =	2337 lbs	= 0.6*qz*GCr*Lunit*(Hunit+Hcurb) (Eq. 29.4-2)
F <sub>h ASD long</sub> =	1578 lbs	= 0.6*qz*GCr*Wunit*(Hunit+Hcurb)
F <sub>vert ASD</sub> =	2548 lbs	= 0.6*qz*GCr*Lunit*Wunit (Eq. 29.4-3)

**Curb Loading**

<b>Transverse:</b>		
Compression <sub>SEISMIC</sub> =	3550 lbs	= [FpmaxASD*Hcm + 2*(1+0.14S <sub>DS</sub> )*Wtmax*wcurb]/wcurb
Tension <sub>SEISMIC</sub> =	983 lbs	= [FpmaxASD*Hcm - 2*(0.6-0.14S <sub>DS</sub> )*Wtmin*wcurb]/wcurb
Compression <sub>WIND</sub> =	552 lbs	= [F <sub>h ASD trans</sub> *Hcm + 2*0.6*Wtmax*wcurb - F <sub>vert ASD</sub> *wcurb/2]/wcurb
Tension <sub>WIND</sub> =	1643 lbs	= [F <sub>h ASD trans</sub> *Hcm - 2*0.6*Wtmin*wcurb + F <sub>vert ASD</sub> *wcurb/2]/wcurb

---> Negative values indicate opposite load.

<b>Longitudinal:</b>		
Compression <sub>SEISMIC</sub> =	3162 lbs	= [FpmaxASD*Hcm + 2*(1+0.14*S <sub>DS</sub> )*Wtmax*Lcurb]/Lcurb
Tension <sub>SEISMIC</sub> =	595 lbs	= [FpmaxASD*Hcm - 2*(0.6-0.14S <sub>DS</sub> )*Wtmin*Lcurb]/Lcurb
Compression <sub>WIND</sub> =	146 lbs	= [F <sub>h ASD long</sub> *Hcm + 2*0.6*Wtmax*Lcurb - F <sub>vert ASD</sub> *Lcurb/2]/Lcurb
Tension <sub>WIND</sub> =	1237 lbs	= [F <sub>h ASD long</sub> *Hcm - 2*0.6*Wtmin*Lcurb + F <sub>vert ASD</sub> *Lcurb/2]/Lcurb

---> Negative values indicate opposite load.

**Governing Reactions:**

<b>Transverse:</b>			
(on long edge)	Comp <sub>MAX</sub> =	3550 lbs	---> Along long edge of curb.
	Tens <sub>MAX</sub> =	1643 lbs	---> Along long edge of curb.
<b>Longitudinal:</b>			
(on short edge)	Comp <sub>MAX</sub> =	3162 lbs	---> Along short edge of curb.
	Tens <sub>MAX</sub> =	1237 lbs	---> Along short edge of curb.

---> Negative values indicate opposite load.




**Curb Design**

Fy = 50 ksi      Fu = 65 ksi  
E = 29500 ksi      t = 0.0713 14 Gauge

**Calculate Section Properties of Curb**

A' = <span style="border: 1px solid black; padding: 2px;">14.000</span> in	a = 13.644 in = A' - (2r+t)
B' = <span style="border: 1px solid black; padding: 2px;">1.750</span> in	a' = 13.929 in = A' - t
C' = <span style="border: 1px solid black; padding: 2px;">0.000</span> in (0 if no tips)	b = 1.572 in = B' - [r+t/2+a(r+t/2)]
α = <span style="border: 1px solid black; padding: 2px;">0.000</span> (0 - no Lip; 1 w/ lip)	b' = 1.714 in = B' - [t/2+αt/2]
R = 0.1069 (Inside bend radius)	c = 0.000 in = α[C' - (r+t/2)]
t = 0.0713 in	c' = 0.000 in = α[C' - t/2]
r' = 0.143 in = R+t/2	u = 0.224 in = πr/2
x = 0.171 in (Distance between centroid and web centerline)	
Ix = 27.499 in <sup>4</sup>	rx = 4.73 in
Iy = 0.204 in <sup>4</sup>	ry = 0.407 in
A = 1.23 in <sup>2</sup>	rmin = 0.407 in

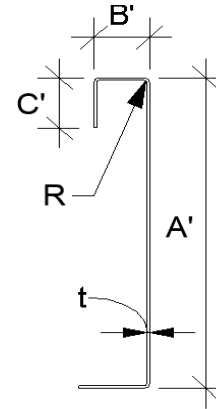

**Axial Compression**

Pu = 1.832 k      (Max Axial Comp)      Ωc = 1.80  
Pn/Ωc = 17.057 k  
Fe = 30.16 ksi  
λc = 1.29  
Fn = 24.98 ksi  
Ly = 50 in  
kyLy/ry = 98

$$\frac{P_n}{\Omega_c} = \frac{F_n A}{\Omega_c} \quad \text{If } \lambda_c \leq 1.5; F_n = (0.658 \lambda_c^2) F_y$$

$$\frac{P_n}{\Omega_c} = \frac{F_n A}{\Omega_c} \quad \text{If } \lambda_c > 1.5; F_n = \frac{0.877}{\lambda_c^2} F_y$$

$$\lambda_c = \sqrt{\frac{F_y}{F_e}} \quad F_e = \frac{\pi^2 E}{(kl/r)^2}$$

Lateral unbraced length  
(assume k=0.8)

**Compression Check = O.K.**

**Check Web Crippling**

h = 14 in	-- Check limits:	C = 4.00	} (See table C3.4.1-2, fastened to support, one flange, end loading)
t = 0.0713 in	h/t = 196.35 ≤ 200	CR = 0.14	
N = 7.00	N/t = 98.18 ≤ 210	CN = 0.35	
Ωw = 1.75	N/h = 0.5 ≤ 2.0	Ch = 0.02	
Pn = 2.422 k	R/t = 1.50 ≤ 9.0		
Pn/Ωw = 1.384 k			
Long side: PuTrans = 1.183 k	<b>O.K.</b> # clips = 3	$P_n = Ct^2 F_y \sin(90) \left(1 - C_R \sqrt{\frac{R}{t}}\right) \left(1 + C_N \sqrt{\frac{N}{t}}\right) \left(1 - C_h \sqrt{\frac{h}{t}}\right)$	
Short side: PuLong = 1.054 k	<b>O.K.</b> # clips = 3		

**Check Web Stiffener**

16Ga x 3/4" x 7" [C-channel]  
width of stiffener = 7.000 in      ts = 0.0566 16 Gauge  
web of stiff. w = 6.717 in      Rs = 0.0849 in  
\*\*\*Check w/ts ≤ 1.28√E/Fys      Ωc = 1.70  
w/ts = 118.675  
1.28√E/Fys = 31.091 --> w/ts over limit Use C3.7.2  
Pn = 0.7(Pwc + AeFy) ≥ Pwc  
Pwc = 2.422 k      Ae = 0.380 in<sup>2</sup>  
Pn = 15.002 k      Pn/Ω = 8.825 k

**Not Req'd**

**Corner Connections**

**1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts**  
Tcrnmax = 974 lbs      Max[FpmaxASD/4 -OR- FhASDtrans/4 corner connections]  
Vcrnmax = 1775 lbs      Max[Tens/2 -OR- Comp/2 corner connections per side]  
Bolt: Tall = 2480 lbs      Vall = 1208 lbs  
Threaded Insert: Tall = 2860 lbs      Vall = 1536 lbs  
# of Bolts required for Tension = 0.4  
# of Bolts required for Shear = 1.5  
# of Bolts Used = 3.0  
Check Combined Stress in Bolts & Inserts: 0.621 **O.K.**

**Check 1/8" welded connection**

<--- USE WELD      Ω = 2.35  
Assume L/t > 25: 25\*t = 1.783 in      Pn/Ω = 1/Ω \* 0.75tLu ≥ Vreq      Lreq'd = VreqΩ / 0.75tFu  
Lreq'd = 1.200 in



### Connection Unit to Curb Clip

#10 SMS screw

$\Omega = 3.0$

$t_1 = 0.0713$  in  
 $t_2 = 0.1017$  in (unit base rail thickness)  
 $d = 0.190$  in (screw diameter)  
 $dw = 0.375$  in (nom. washer diameter)

$Fu_1 = 65$  ksi  
 $Fu_2 = 65$  ksi

For  $t_2/t_1 \leq 1.0$ :

**Shear:**  $P_{ns} = 4.2F_{u2}\sqrt{t_2^3d}$  3.86 k  
 $P_{ns} = 2.7t_1dF_{u1}$  2.38 k  
 $P_{ns} = 2.7t_2dF_{u2}$  3.39 k

For  $t_2/t_1 \geq 2.5$ :

$P_{ns} = 2377$  #  
 $P_{ns} = 2.7t_1dF_{u1}$  2.38 k  
 $P_{ns} = 2.7t_2dF_{u2}$  3.39 k

$P_{ns}/\Omega = 792$  #

$P_{ss}/\Omega = 540$  # <- Controls

**Tension:**  $P_{not} = 1.068$  k (screw pull-out strength)  $P_{not} = 0.85t_c d F_{u2}$

$P_{nov} = 2.607$  k (screw pull-over strength)  $t_c = \min(t_1, t_2)$

$P_{ts}/\Omega = 356$  # <- Controls  $P_{nov} = 1.5t_1 d_w F_{u1}$

$P_{ts}/\Omega = 820$  # (full tensile screw capacity)

	Shear (k)	# clips	$V_{clip}$ (k)	$V_{allow}$ (lb)	# screws	spacing
Long side:	3.664	3	1.22	540 #	3	3.00 in
Short side:	3.664	3	1.22	540 #	3	3.00 in

clip width (in) = 7.00

clip height = 1.4 in

min spacing = 0.57 in

edge distance = 0.5 in (min. 1.5d)

Check Block shear rupture: O.K.

thinnest part = 0.0713 AISI BSR applies

$F_y = 50$  ksi

$\Omega = 2.22$  bolt/screw connection

$A_{gv} = 0.463$  in<sup>2</sup>

$A_{nv} = 0.430$  in<sup>2</sup>


$A_{nt} = 0.042$  in<sup>2</sup>

$R_n/\Omega = 7.500$  k

$R_n = 0.6F_y A_{gv} + F_u A_{nt} \leq 0.6F_u A_{nv} + F_u A_{nt}$

**BSR O.K.**

(AISI Sect. E5.3)

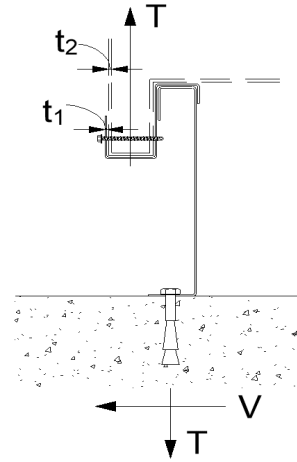

### Connection of Curb to Supporting Structure

#### Roof Loading

SEISMIC:  $(0.6-0.14S_{DS})D + 0.7E$

WIND:  $0.6D + W$

Transverse:	Uplift <sub>MAX</sub> = 3112 lbs	Shear <sub>MAX</sub> = 1947 lbs
Compression <sub>SEISMIC</sub> =	4026 lbs	$= [F_{pmax} ASD * (H_{cm} + H_{curb}) + (1 + 0.14 S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$
Tension <sub>SEISMIC</sub> =	3112 lbs	$= [F_{pmax} ASD * (H_{cm} + H_{curb}) - (0.6 - 0.14 S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$
Compression <sub>WIND</sub> =	830 lbs	$= [F_{h ASD trans} * (H_{cm} + H_{curb}) + 0.6 * WGT_{unit+curb} * w_{curb}/2 - F_{vert ASD} * w_{curb}/2] / w_{curb}$
Tension <sub>WIND</sub> =	1426 lbs	$= [F_{h ASD trans} * (H_{cm} + H_{curb}) - 0.6 * WGT_{unit+curb} * w_{curb}/2 + F_{vert ASD} * w_{curb}/2] / w_{curb}$
Longitudinal:	Uplift <sub>MAX</sub> = 2481 lbs	Shear <sub>MAX</sub> = 1947 lbs
Compression <sub>SEISMIC</sub> =	3394 lbs	$= [F_{pmax} ASD * (H_{cm} + H_{curb}) + (1 + 0.14 S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$
Tension <sub>SEISMIC</sub> =	2481 lbs	$= [F_{pmax} ASD * (H_{cm} + H_{curb}) - (0.6 - 0.14 S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$
Compression <sub>WIND</sub> =	208 lbs	$= [F_{h ASD long} * (H_{cm} + H_{curb}) + 0.6 * WGT_{unit+curb} * L_{curb}/2 - F_{vert ASD} * L_{curb}/2] / L_{curb}$
Tension <sub>WIND</sub> =	804 lbs	$= [F_{h ASD long} * (H_{cm} + H_{curb}) - 0.6 * WGT_{unit+curb} * L_{curb}/2 + F_{vert ASD} * L_{curb}/2] / L_{curb}$

#### Wood Attachment:

1/4" φ x 3.5" Simpson SDS screw w/ 2.25" threaded emt (SGmin = 0.43)

Transverse:	$T_{all metal} = 997$ lbs	$V_{all metal} = 1097$ lbs
	$T_{all wood} = 616$ lbs	$V_{all wood} = 672$ lbs
# of Screws Req'd for Uplift =	5.05	COMBINED LOADING: 0.795 O.K.
# of Screws Req'd for Shear =	2.90	Screw Spacing = 13.1 in o.c.
Total # of screws Required =	10	

1/4" φ x 3.5" Simpson SDS screws @ 13.1 in o.c. along long side of curb w/ 2.25" threaded embed

#### Longitudinal:

# of Screws Req'd for Uplift =	4.0	COMBINED LOADING: 0.769 O.K.
# of Screws Req'd for Shear =	2.9	Screw Spacing = 9.4 in o.c.
Total # of screws Required =	9	

1/4" φ x 3.5" Simpson SDS screws @ 9.4 in o.c. along short side of curb w/ 2.25" threaded embed

#### Steel Deck Attachment:

1/2" φ A307 Bolts to steel angle below deck

Transverse:	$T_{all bolt} = 3927$ lbs	$V_{all bolt} = 2209$ lbs
	$T_{all metal} = 2086$ lbs	$V_{all metal} = 2192$ lbs
# of Bolts Req'd for Uplift =	1.49	COMBINED LOADING: 0.444 O.K.
# of Bolts Req'd for Shear =	0.89	Bolt Spacing = 56.9 in o.c.
Total # of Bolts Required =	3	

1/2" φ A307 Bolts to steel angle below deck @ 56.9 in o.c. along long side of curb

#### Longitudinal:

# of Bolts Req'd for Uplift =	1.19	COMBINED LOADING: 0.679 O.K.
# of Bolts Req'd for Shear =	0.89	Req'd Min Spacing = 71.5 in o.c.
Total # of Bolts Required =	2	

1/2" φ A307 Bolts to steel angle below deck @ 71.5 in o.c. along short side of curb



**For Concrete anchorage:** SEISMIC  $(0.6-0.14S_{DS})D + 0.7\Omega_o E$   $\Omega_o = 2.0$

**Concrete Attachment:** 3/4"  $\phi$  thrd'd rods in Hilti Hit-HY 200 epoxy w/ 4" embed

$T_{all,LRFD} = 1722 \text{ lbs}$   $V_{all,LRFD} = 2032 \text{ lbs}$   $\alpha = (1 + 0.2SDS)D + 2.5E = 1.708$

$T_{all,ASD} = T_{all,LRFD}/\alpha = 920.9 \text{ lbs}$   $V_{all,ASD} = V_{all,LRFD}/\alpha = 1086.6 \text{ lbs}$   $(D = 0.758, E = 0.242)$

**Transverse:** Uplift<sub>MAX</sub> = 3303 lbs Shear<sub>MAX</sub> = 3894 lbs

Compression<sub>SEISMIC</sub> = 5906 lbs =  $[\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$   
 Tension<sub>SEISMIC</sub> = 3303 lbs =  $[\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * w_{curb}/2] / w_{curb}$   
 Shear<sub>SEISMIC</sub> = 3894 lbs =  $\Omega_o * F_{pmaxASD} / 2$   
 Min Bolts Req'd Uplift = 3.59 spacing = 37.92 in o.c. T<sub>applied</sub> = 330.3 lbs  
 Min Bolts Req'd Shear = 3.58 spacing = 37.92 in o.c. V<sub>applied</sub> = 216.3 lbs

Try using 10 bolts spaced at 12.64 in o.c.	COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 0.56$
--	--

Use 10 - 3/4"  $\phi$  thrd'd rods in Hilti Hit-HY 200 epoxy @ 12.6 in o.c. max. along long side of curb w/ 4" embed

**Longitudinal:** Uplift<sub>MAX</sub> = 2040 lbs Shear<sub>MAX</sub> = 3894 lbs

Compression<sub>SEISMIC</sub> = 4643 lbs =  $[\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$   
 Tension<sub>SEISMIC</sub> = 2040 lbs =  $[\Omega_o * F_{pmaxASD} * (H_{cm} + H_{curb}) - (0.6 - 0.14S_{DS}) * WGT_{unit+curb} * L_{curb}/2] / L_{curb}$   
 Shear<sub>SEISMIC</sub> = 3894 lbs =  $\Omega_o * F_{pmaxASD} / 2$   
 Min Bolts Req'd Uplift = 2.22 spacing = 35.75 in o.c. T<sub>applied</sub> = 255.0 lbs  
 Min Bolts Req'd Shear = 3.58 spacing = 23.83 in o.c. V<sub>applied</sub> = 216.3 lbs

Try using 8 bolts spaced at 10.21 in o.c.	COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 0.48$
---	--

Use 8 - 3/4"  $\phi$  thrd'd rods in Hilti Hit-HY 200 epoxy @ 10.2 in o.c. max. along short side of curb w/ 4" embed

<b>CURB DESIGN SUMMARY:</b> CBKD-136 KDKITSLM1830		<b>Unit:</b> ZJ,ZR 180-300; ZF 210-300; XP 180-240
CURB RAIL THICKNESS: 0.0713 in 14 Gauge		
UNIT CLIP THICKNESS: 0.0713 in 14 Gauge		
# OF CLIPS (LONG SIDE) - 3 clips with 3 - #10 SMS screws each clip		
WEB STIFFENER: NOT REQUIRED		
# OF CLIPS (SHORT SIDE) - 3 clips with 3 - #10 SMS screws each clip		
WEB STIFFENER: NOT REQUIRED		
CORNER CONNECTION: Use 3 - 1/4" $\phi$ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts		
<b>CURB ANCHORAGE</b>	<b>WOOD</b>	<b>STEEL</b>
	1/4" $\phi$ x 3.5" Simpson SDS screws w/ 2.25" threaded embed	1/2" $\phi$ A307 Bolts to steel angle below deck
	<b>CONCRETE</b>	
	3/4" $\phi$ thrd'd rod in Hilti HIT-HY 200 epoxy, min. 4" embed	
<b>LONG DIRECTION</b>	10 @ 13.08 in o.c.	3 @ 56.88 in o.c.
<b>SHORT DIRECTION</b>	9 @ 9.44 in o.c.	2 @ 71.5 in o.c.
		10 @ 12.64 in o.c.
		8 @ 10.21 in o.c.