



**MOUR GROUP**  
ENGINEERING + DESIGN

6593 Riverdale St.  
San Diego, CA 92120

619-727-4800

## **Structural Calculations**

**for**

## **CBKD-161 Roof Curb**

Kit #80-266-50\*\*

2017 Florida Building Code requirements



**Prepared for:**

**PROVENT**


3847 Wabash Drive  
Mira Loma, CA 91725

**Date: June 15, 2018**

**Project Number: PV1807**

**STEEL ATTACHMENT**

CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 5/8" Ø A307 BOLTS ATTACHED TO STEEL ANGLE BELOW DECK AT EACH CONNECTION POINT.

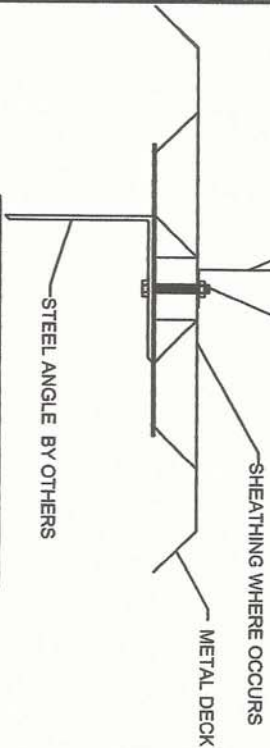

CURB KIT	NO. OF ANCHORAGE BOLTS REQUIRED		UNIT
	LONG SIDE *	SHORT SIDE *	
80-266-49	2 @ 34.5" o.c.	2 @ 19" o.c.	LXS
80-266-50	2 @ 34.5" o.c.	2 @ 29" o.c.	LXL
80-266-13	2 @ 61" o.c.	2 @ 25.3" o.c.	SUNLINE 3-6 TON
80-266-45	2 @ 58.4" o.c.	2 @ 28.2" o.c.	PRESTIGE SMALL
80-266-46	2 @ 72" o.c.	2 @ 41" o.c.	PRESTIGE LARGE
80-266-29	3 @ 34.7" o.c.	2 @ 39.5" o.c.	PREDATOR
80-266-19	3 @ 51.6" o.c.	2 @ 72" o.c.	ULTRA
80-266-18	4 @ 38.1" o.c.	3 @ 38" o.c.	SUNLINE 15-25 TON

**WIND AND SEISMIC LOAD ROOF ANCHORAGE DETAIL**

Meets wind, seismic requirements for the following codes:  
 FBC 2017  
 based on ASCE 7-10.

**Wind:**  
 190 mph exposure D category III or IV building, max BLDG height: 60 ft  
 Kzt=1.00 max

**Seismic:**  
 Sds=0.30 max  
 Sd1=0.187 max  
 Site Class D  
 Importance Factor: Ip=1.5

**CONCRETE ATTACHMENT**

CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 3/4" Ø THRD'D ROD IN HILTI HIT-HY 200 EPOXY, 4" MIN. EMBED INTO CONCRETE.




CURB KIT	NO. OF ANCHORAGE BOLTS REQUIRED		UNIT
	LONG SIDE *	SHORT SIDE **	
80-266-49	5 @ 8.6" o.c.	4 @ 6.3" o.c.	LXS
80-266-50	5 @ 8.6" o.c.	5 @ 7.25" o.c.	LXL
80-266-13	9 @ 7.63" o.c.	6 @ 5.1" o.c.	SUNLINE 3-6 TON
80-266-45	6 @ 11.7" o.c.	4 @ 9.4" o.c.	PRESTIGE SMALL
80-266-46	6 @ 14.4" o.c.	5 @ 10.25" o.c.	PRESTIGE LARGE
80-266-29	16 @ 4.63" o.c.	10 @ 4.4" o.c.	PREDATOR
80-266-19	15 @ 7.4" o.c.	12 @ 6.5" o.c.	ULTRA
80-266-18	22 @ 5.4" o.c.	17 @ 4.5" o.c.	SUNLINE 15-25 TON

- NORMAL WEIGHT CONC SLAB
- f'c=4000 PSI MIN
- 6" MIN THICK CONC.
- SPECIAL INSPECTION REQUIRED (ESR-3187)

**WOOD ATTACHMENT**

CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 5/8" Ø WOOD LAG SCREWS (3.5" MIN. EMBED. INTO WOOD FRAMING)




CURB KIT	NO. OF ANCHORAGE SCREWS REQUIRED		UNIT
	LONG SIDE	SHORT SIDE	
80-266-49	5 @ 9.6" o.c.	3 @ 11.5" o.c.	LXS
80-266-50	5 @ 9.6" o.c.	5 @ 8.3" o.c.	LXL
80-266-13	8 @ 9.3" o.c.	4 @ 9.8" o.c.	SUNLINE 3-6 TON
80-266-45	6 @ 12.5" o.c.	3 @ 16.1" o.c.	PRESTIGE SMALL
80-266-46	6 @ 15.2" o.c.	4 @ 15" o.c.	PRESTIGE LARGE
80-266-29	14 @ 5.6" o.c.	7 @ 7.3" o.c.	PREDATOR
80-266-19	15 @ 7.7" o.c.	12 @ 6.9" o.c.	ULTRA
80-266-18	23 @ 5.4" o.c.	14 @ 5.8" o.c.	SUNLINE 15-25 TON

FOUR INCHES FROM EACH CORNER EVENLY SPACED.


**STEEL AND CONCRETE ANCHORS ARE 6" FROM EACH CORNER EVENLY SPACED**

**CONCRETE OVER METAL DECK**

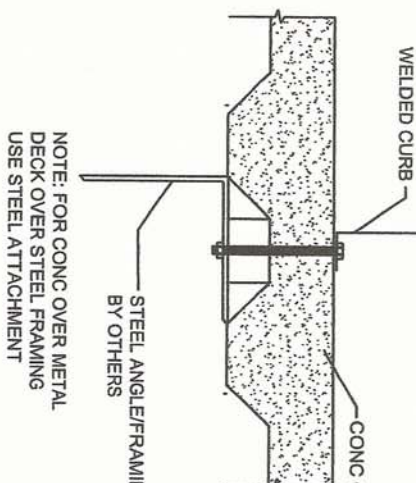

NOTE: FOR CONC OVER METAL DECK OVER STEEL FRAMING USE STEEL ATTACHMENT

FORM NO: CB-25

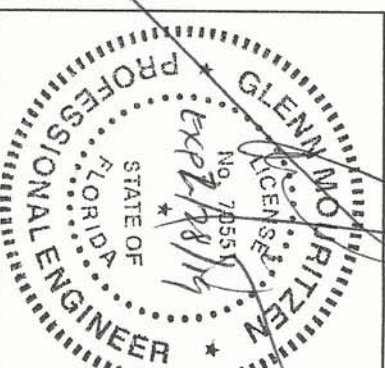

3847 WABASH DR.  
 MIRA LOMA, CA 91725  
 PHONE (951) 685-1101  
 FAX (619) 872-9799

SUBMITTED TO:  
 COMPANY:  
 JOB NAME:  
 EQUIPMENT:  
 NOTES:

DATE: 06/06/18

REV: 7

DRAWN BY: ALL

For wood, concrete and steel attachments see Roof Anchorage Detail, Form No. CB-26.

Will conform to wind load code requirements for knock-down or pre-assembled application. (Contact factory for assembled version.)

**CALCULATED WIND AND SEISMIC ROOF CURBS FOR YORK UNITS**

**P\*\*\*B ALL MODELS**

ProVent P/N	A	WEIGHT	CALCULATED KIT P/N	WEIGHT
80-266-5014	14"	111 Lbs	80-266-5014	28 Lbs
80-266-5018	18"	130 Lbs	80-266-5018	33 Lbs








Meets wind, seismic requirements for the following codes:  
 FBC 2017  
 based on ASCE 7-10.

Wind:

190 mph exposure D category III or IV building, max BLDG height: 60 ft  
 Kz1=1.00 max

Seismic:

Sds=0.30 max  
 Sd1=0.187 max  
 Site Class D  
 Importance Factor: I<sub>p</sub>=1.5

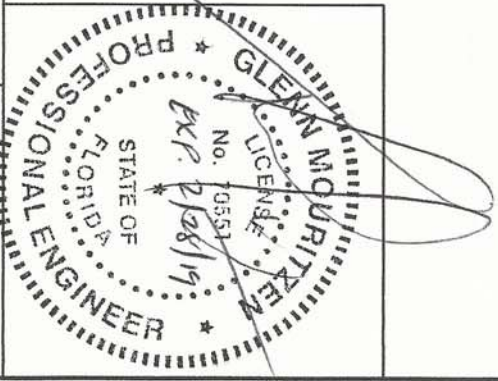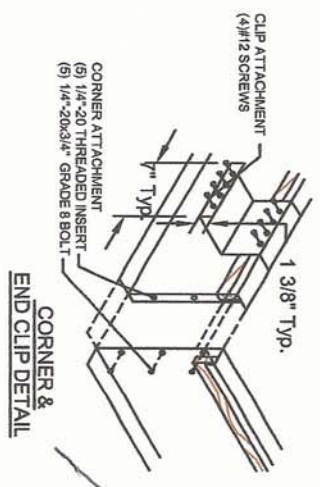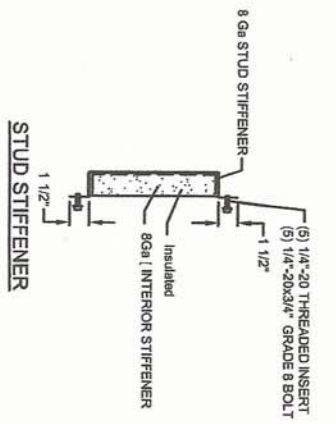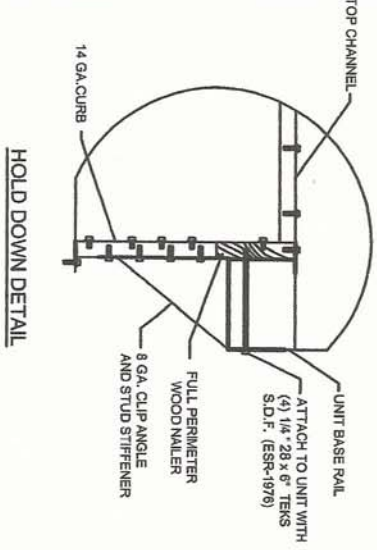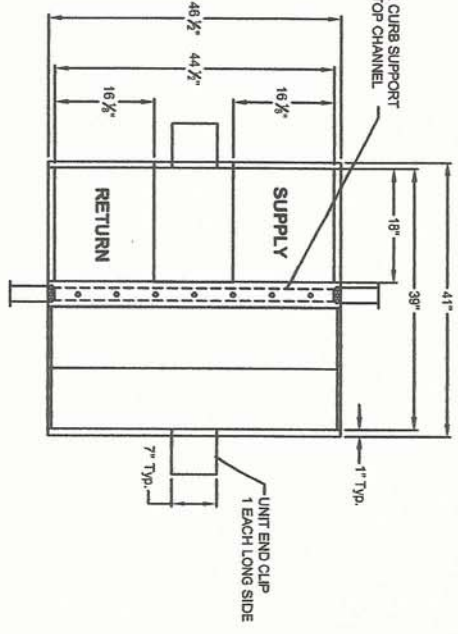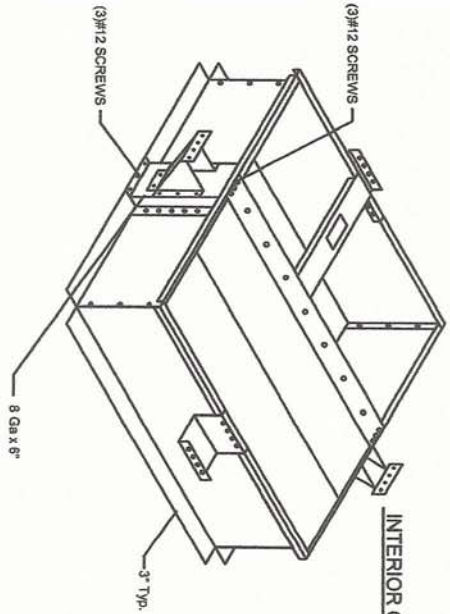

3847 WABASH DR.  
 MIRA LOMA, CA 91725  
 PHONE (951) 685-1101  
 FAX (619) 872-9799

SUBMITTED TO: \_\_\_\_\_  
 COMPANY: \_\_\_\_\_  
 JOB NAME: \_\_\_\_\_  
 EQUIPMENT: \_\_\_\_\_  
 NOTES: \_\_\_\_\_

FORM NO: CBKD-161  
 DATE: 6/12/18  
 REV: 3

PART NUMBER: 80-266-50  
 DRAWN BY: JG




Client:	ProVent	PV1807
Description:	CBKD-161	(80-266-50**)
Unit:	York - All P***B models	

**Curb Information**

Hcurb =	18	in	(Height of curb)
Lcurb =	46.5	in	(Length of curb)
wcurb =	41	in	(Width of curb)
WGTCurb =	163	lbs	(Weight of curb)

**Unit Information**

WGUnit =	420	lbs	(Weight of Unit)
Wtmax =	141	lbs	(Maximum corner weight)
Wtmin =	78	lbs	(Minimum corner weight)
Hunit =	55	in	(Height of unit above curb)
Hcm =	27.5	in	(Height to center of mass)
Lunit =	51.25	in	(Length of unit)
Wunit =	45.75	in	(Width of unit)

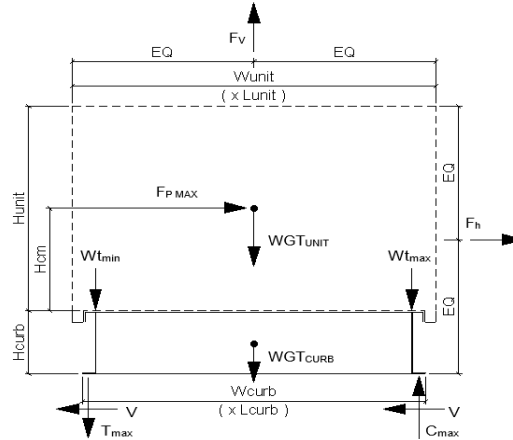

**Seismic Loading - 2017 FBC/2015 IBC**

Ss =	0.15	(Worst Case for state of Florida)
Fa =	2.5	(Worst case Site class E from Table 11.4-1 ASCE 7-10)
Sms =	0.375	(Fa*Ss)
Sds =	0.250	(2/3*Sms)
Ip =	1.5	(Importance Factor Category III or IV Building)
Fpmax =	0.6000	Wp
FpmaxASD =	176	lbs
	(unit only)	
FpmaxASD =	245	lbs
	(unit and curb)	

**Wind Loading - 2017 FBC/2015 IBC**

\*\*\* Exposure Category D \*\*\*

Kz =	1.31	(For 60 ft roof height, Exposure D - Table 29.3-1 ACSE 7-10)
Kzt =	1.0	(No topographic effects assumed for rooftop mounted units)
Kd =	0.85	(Directionality factor Table 26.6-1 ASCE 7-10)
V =	190	(Wind velocity, mph for Occupancy Cat III-IV bldgs Exp. Cat D)
GCr <sub>(horiz)</sub> =	1.9	(Refer Sect 29.5.1 ASCE 7-10)
GCr <sub>(vert)</sub> =	1.5	(Refer Sect 29.5.1 ASCE 7-10)
qz =	102.9	psf = 0.00256*Kz*Kzt*Kd*V <sup>2</sup> (Eq. 29.3-1 ASCE 7-10)
F <sub>h ASD trans</sub> =	3048	lbs = 0.6*qz*GCr*Lunit*(Hunit+Hcurb) (Eq. 29.5-2)
F <sub>h ASD long</sub> =	2721	lbs = 0.6*qz*GCr*Wunit*(Hunit+Hcurb)
F <sub>vert ASD</sub> =	1508	lbs = 0.6*qz*GCr*Lunit*Wunit (Eq. 29.5-3)

**Curb Loading**

<b>Transverse:</b>		
Compression <sub>SEISMIC</sub> =	410	lbs = [FpmaxASD*Hcm+2*(1+0.14S <sub>DS</sub> )*Wtmax*wcurb]/wcurb
Tension <sub>SEISMIC</sub> =	173	lbs = Comp <sub>SEISMIC</sub> - (0.6-0.14S <sub>DS</sub> )*WGUnit
Compression <sub>WIND</sub> =	1460	lbs = [F <sub>h trans ASD</sub> *Hcm+2*0.6*Wtmax*wcurb-F <sub>vert ASD</sub> *wcurb/2]/wcurb
Tension <sub>WIND</sub> =	2716	lbs = Comp <sub>WIND</sub> +F <sub>vert</sub> -0.6*WGUnit
	----> Negative values indicate Compression load rather than Tension.	
<b>Longitudinal:</b>		
Compression <sub>SEISMIC</sub> =	396	lbs = [FpmaxASD*Hcm+2*(1+0.14*S <sub>DS</sub> )*Wtmax*Lcurb]/Lcurb
Tension <sub>SEISMIC</sub> =	159	lbs = Comp <sub>SEISMIC</sub> - (0.6-0.14S <sub>DS</sub> )*WGUnit
Compression <sub>WIND</sub> =	1024	lbs = [F <sub>h trans ASD</sub> *Hcm+2*0.6*Wtmax*Lcurb-F <sub>vert ASD</sub> *Lcurb/2]/Lcurb
Tension <sub>WIND</sub> =	2280	lbs = Comp <sub>WIND</sub> +F <sub>vert</sub> -0.6*WGUnit
	----> Negative values indicate Compression load rather than Tension.	

**Governing Reactions:**

<b>Transverse:</b>	Comp <sub>MAX</sub> =	1460	lbs	----> Along long edge of curb.
(on long edge)	Tens <sub>MAX</sub> =	2716	lbs	----> Along long edge of curb.
<b>Longitudinal:</b>	Comp <sub>MAX</sub> =	1024	lbs	----> Along short edge of curb.
(on short edge)	Tens <sub>MAX</sub> =	2280	lbs	----> Along short edge of curb.


----> Negative values indicate Compression load rather than Tension.

**Curb Design**

Fy = 50 ksi      Fu = 65 ksi      t = 0.0713 14 Gauge  
E = 29500 ksi

**Calculate Section Properties of Curb**

A' = <span style="border: 1px solid black; padding: 2px;">18.000</span> in	a = 17.644 in = A' - (2r+t)
B' = <span style="border: 1px solid black; padding: 2px;">2.000</span> in	a' = 17.929 in = A' - t
C' = <span style="border: 1px solid black; padding: 2px;">0.000</span> in [0 if no lips]	b = 1.822 in = B' - [r+t/2+a(r+t/2)]
α = <span style="border: 1px solid black; padding: 2px;">0.000</span> [0 - no Lip; 1 w/ lip]	b' = 1.964 in = B' - [t/2+at/2]
R = 0.1069 [Inside bend radius]	c = 0.000 in = a[C' - (r+t/2)]
t = 0.0713 in	c' = 0.000 in = a[C' - t/2]
r' = 0.143 in = R+t/2	u = 0.224 in = πr/2
x = 0.178 in [Distance between centroid and web centerline]	
Ix = 56.073 in <sup>4</sup> [Moment of Inertia about X-Axis]	
Iy = 0.311 in <sup>4</sup> [Moment of Inertia about Y-Axis]	
A = 1.55 in <sup>2</sup>	
rx = 6.02 in	
ry = 0.448 in	
rmin = 0.448 in	

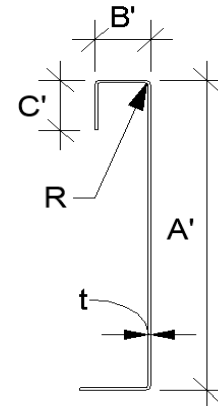

**Axial Compression**

Pu = 1.524 k	(Max Axial Comp)	Ωc = 1.80
Pn/Ωc = 24.287 k		
Fe = 36.56 ksi		
λc = 1.17		
Fn = 28.21 ksi		
Ly = 50 in	Lateral unbraced length	
kyLy/ry = 89	(assume k=0.8)	

$$\lambda_c = \frac{F_y}{F_e} \quad F_e = \frac{\pi^2 E}{(kl/r)^2}$$

$$P_n = \begin{cases} F_n A & \text{If } \lambda_c \leq 1.5; \\ \frac{0.877}{\lambda_c^2} F_y A & \text{If } \lambda_c > 1.5; \end{cases}$$

**Compression Check = O.K.**

**Check Web Crippling**

h = 18 in	-- Check limits:	C = 4.00	} (See table C3.4.1-2, fastened to support, one flange, end loading)
t = 0.0713 in	h/t = 252.45 ≤ 200	CR = 0.14	
N = 7.00	N/t = 98.18 ≤ 210	CN = 0.35	
Ωw = 1.75	N/h = 0.388889 ≤ 2.0	Ch = 0.02	
Pn = 2.296 k	R/t = 1.50 ≤ 9.0		

$$P_n = Ct^2 F_y \sin(90) \left(1 - C_R \sqrt{\frac{R}{t}}\right) \left(1 + C_N \sqrt{\frac{N}{t}}\right) \left(1 - C_h \sqrt{\frac{h}{t}}\right)$$

Long side: Pu<sub>Trans</sub> = 1.460 k **web stiffener REQ'D** # clips = 1

Short side: Pu<sub>Long</sub> = 1.024 k **O.K.** # clips = 1

**\*\*\*h/t > 200; use web stiffeners**

**Check Web Stiffener**

16Ga x 3/4" x 7" [C-channel]

width of stiffener = 7.000 in	ts = 0.0566 <span style="border: 1px solid black; padding: 2px;">16 Gauge</span>
web of stiff. w = 6.717 in	Rs = 0.0849 in
***Check w/ts ≤ 1.28√E/Fys	Ωc = 1.70
w/ts = 118.675	
1.28√E/Fys = 31.091	--> w/ts over limit Use C3.7.2
Pn = 0.7(Pwc + AeFy) ≥ Pwc	
Pwc = 2.296 k	Ae = 0.380 in <sup>2</sup>
Pn = 14.913 k	Pn/Ω = 8.773 k

**O.K.**

**Corner Connections**

**1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts**

Tcrnmax = 762 lbs	Max(FpmaxASD/4 -OR- FhASDtrans/4 corner connections)
Vcrnmax = 1358 lbs	(Max Ten/2 corner connections per side)
Bolt: Tall = <span style="border: 1px solid black; padding: 2px;">2480</span> lbs	Vall = <span style="border: 1px solid black; padding: 2px;">1096</span> lbs
Threaded Insert: Tall = <span style="border: 1px solid black; padding: 2px;">2860</span> lbs	Vall = <span style="border: 1px solid black; padding: 2px;">1714</span> lbs
# of Bolts required for Tension = 0.3	
# of Bolts required for Shear = 1.2	
# of Bolts Used = <span style="border: 1px solid black; padding: 2px;">2.0</span>	
Check Combined Stress in Bolts & Inserts: 0.773 <b>O.K.</b>	StressComb = 0.515 <b>O.K.</b>

\*\*\*If combined fails: USE --> 3.0

**Check 1/8" welded connection**

<--- USE WELD      Ω = 2.35

Assume L/t > 25\*t = 1.783 in      Pn/Ω = 1/Ω \* 0.75tLu ≥ Vreq      Lreq'd = VreqΩ / 0.75tFu

Lreq'd = 0.918 in



### Connection Unit to Curb Clip

#12 SMS screw

$\Omega = 3.0$

$t_1 = 0.0713$  in

$F_{u1} = 65$  ksi

$t_2 = 0.1017$  in (unit base rail thickness)

$F_{u2} = 65$  ksi

$d = 0.216$  in (screw diameter)

$d_w = 0.375$  in (nom. washer diameter)

$t_2/t_1 = 1.4$

For  $t_2/t_1 \leq 1.0$ :

**Shear:**  $P_{ns} = 4.2F_{u2}\sqrt{t_2^3d}$  4.12 k

$P_{ns} = 2.7t_1dF_{u1}$  2.70 k

$P_{ns} = 2.7t_2dF_{u2}$  3.86 k

$P_{ns}/\Omega = 901$  #

$P_{ss}/\Omega = 840$  # <- Controls

**Tension:**  $P_{not} = 1.214$  k (screw pull-out strength)

$P_{nov} = 2.607$  k (screw pull-over strength)

$P_{ts}/\Omega = 405$  # <- Controls

$P_{ts}/\Omega = 845$  #

$P_{ns} = 2703$  #

For  $t_2/t_1 \geq 2.5$ :

$P_{ns} = 2703$  #


$P_{ns} = 2.7t_1dF_{u1}$  2.70 k

$P_{ns} = 2.7t_2dF_{u2}$  3.86 k

$P_{not} = 0.85t_c d F_{u2}$

$t_c = \min(t_1, t_2)$

$P_{nov} = 1.5t_1 d_w F_{u1}$

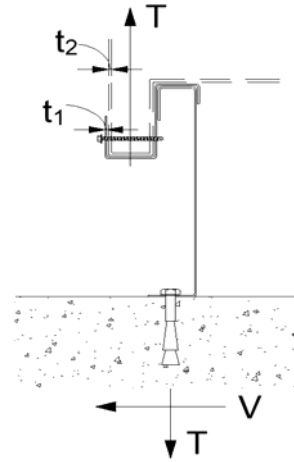

	Shear (k)	# clips	$V_{clip}$ (k)	$V_{allow}$ (lb)	# screws	spacing
--	-----------	---------	----------------	------------------	----------	---------

Long side: 3.048 1 3.05 840 # 4 2.00 in

Short side: 2.721 1 2.72 840 # 4 2.00 in

clip width (in) = 7.00

clip height = 2.5 in

min spacing = 0.65 in

edge distance = 0.5 in (min. 1.5d)

Check Block shear rupture: O.K.

thinnest part = 0.0713 AISI BSR applies

$F_y = 50$  ksi

$\Omega = 2.22$  bolt/screw connection

$A_{gv} = 0.463$  in<sup>2</sup>

$A_{nv} = 0.410$  in<sup>2</sup>

$A_{nt} = 0.081$  in<sup>2</sup>

$R_n/\Omega = 8.647$  k

$R_n = 0.6F_y A_{gv} + F_u A_{nt} \leq 0.6F_u A_{nv} + F_u A_{nt}$   
(AISI Sect. E5.3)

**BSR O.K.**

### Connection of Curb to Supporting Structure

**Roof Loading**

SEISMIC: (0.6-0.14SDS)D + 0.7E

WIND: 0.6D + W

Transverse: Uplift<sub>MAX</sub> = 3961 lbs Shear<sub>MAX</sub> = 1524 lbs

Compression<sub>SEISMIC</sub> = 573 lbs =  $[F_{pmaxASD}(H_{cm}+H_{curb})+(1+0.14SDS)(WGT_{unit+curb}/2)*w_{curb}]/w_{curb}$

Tension<sub>SEISMIC</sub> = 244 lbs =  $Comp_{SEISMIC}-(0.6-0.14SDS)(WGT_{unit+curb})$

Compression<sub>WIND</sub> = 2803 lbs =  $[F_{htransASD}(H_{cm}+H_{curb})+0.6*(WGT_{unit+curb}/2)*w_{curb}-F_{vertASD}*w_{curb}/2]/w_{curb}$

Tension<sub>WIND</sub> = 3961 lbs =  $[F_{htransASD}(H_{cm}+H_{curb})-0.6*(WGT_{unit+curb}/2)*w_{curb}+F_{vertASD}*w_{curb}/2]/w_{curb}$

Longitudinal: Uplift<sub>MAX</sub> = 3241 lbs Shear<sub>MAX</sub> = 1360 lbs

Compression<sub>SEISMIC</sub> = 541 lbs =  $[F_{pmaxASD}(H_{cm}+H_{curb})+(1+0.14SDS)(WGT_{unit+curb}/2)*L_{curb}]/L_{curb}$

Tension<sub>SEISMIC</sub> = 212 lbs =  $Comp_{SEISMIC}-(0.6-0.14SDS)(WGT_{unit+curb})$

Compression<sub>WIND</sub> = 2083 lbs =  $[F_{htransASD}(H_{cm}+H_{curb})+0.6*(WGT_{unit+curb}/2)*L_{curb}-F_{vertASD}*L_{curb}/2]/L_{curb}$

Tension<sub>WIND</sub> = 3241 lbs =  $[F_{htransASD}(H_{cm}+H_{curb})-0.6*(WGT_{unit+curb}/2)*L_{curb}+F_{vertASD}*L_{curb}/2]/L_{curb}$

**Wood Attachment:**

Use 5/8"  $\phi$  wood lag screws

w/ 3.5" Min. Embed

$T_{all,metal} = 946.67$  lbs

$V_{all,metal} = 1043.33$  lbs

Transverse:  $T_{all,wood} = 1195.95$  lbs

$V_{all,wood} = 1024$  lbs

# of Screws Req'd for Uplift = 4.18

COMBINED LOADING: 0.960 O.K.

# of Screws Req'd for Shear = 1.49

Screw Spacing = 9.6 in o.c.

Total # of screws Required = 5

Use 5/8"  $\phi$  wood lag screws @ 9.6 in o.c. along long side of curb w/ 3.5" Min. Embed

Longitudinal:

# of Screws Req'd for Uplift = 3.4

COMBINED LOADING: 0.808 O.K.

# of Screws Req'd for Shear = 1.3

Screw Spacing = 8.3 in o.c.

Total # of screws Required = 5

Use 5/8"  $\phi$  wood lag screws @ 8.3 in o.c. along short side of curb w/ 3.5" Min. Embed

**Steel Deck Attachment:**

Use 5/8"  $\phi$  A307 Bolts attached to steel angle below deck

$T_{all,bolt} = 6903$  lbs

$V_{all,bolt} = 3682$  lbs

Transverse:  $T_{all,bolt} = 6903$  lbs

$V_{all,bolt} = 3682$  lbs

# of Bolts Req'd for Uplift = 0.57

COMBINED LOADING: 0.197 O.K.

# of Bolts Req'd for Shear = 0.41

Bolt Spacing = 34.5 in o.c.

Total # of Bolts Required = 2

Use 5/8"  $\phi$  A307 Bolts attached to steel angle below deck @ 34.5 in o.c. along long side of curb

Longitudinal:

# of Bolts Req'd for Uplift = 0.47

COMBINED LOADING: 0.149 O.K.

# of Bolts Req'd for Shear = 0.37

Req'd Min Spacing = 29.0 in o.c.

Total # of Bolts Required = 2

Use 5/8"  $\phi$  A307 Bolts attached to steel angle below deck @ 29 in o.c. along short side of curb



**For Concrete anchorage:** SEISMIC (0.6-0.14SDS)D + 0.7Ω<sub>o</sub>E (Ω<sub>o</sub> = 2.5)

**Concrete Attachment:** 3/4" φ Hilti Hit-HY 200 adhesive anchors w/ 4" embed

Tall<sub>LRFD</sub> = 1722 lbs Vall<sub>LRFD</sub> = 2032 lbs α = (1 + 0.2SDS)D + 2.5E = 1.87

Tall<sub>ASD</sub> = Tall<sub>LRFD</sub>/α = 920.9 lbs Vall<sub>ASD</sub> = Vall<sub>LRFD</sub>/α = 1086.6 lbs (D = 0.465, E = 0.535)

**Transverse:** Uplift<sub>MAX</sub> = 3961 lbs Shear<sub>MAX</sub> = 1524 lbs

Compression<sub>SEISMIC</sub> = 981 lbs = [2.5 \* FpmaxASD \* (Hcm + Hcurb) + (1 + 0.14SDS) \* (WGT<sub>unit+curb</sub>/2) \* wcurb] / wcurb

Tension<sub>SEISMIC</sub> = 652 lbs = Comp<sub>SEISMIC</sub> - [0.6 - 0.14SDS] \* (WGTunit + curb)

Shear<sub>SEISMIC</sub> = 306 lbs = 2.5 \* FpmaxASD / 2

Min Bolts Req'd Uplift = 4.30 spacing = 5.63 in o.c. TApplied = 792.3 lbs

Min Bolts Req'd Shear = 2.00 spacing = 22.5 in o.c. VApplied = 304.8 lbs

Try using 5 bolts spaced at 8.63 in o.c.	COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 1.14$
--	--

Use 5 - 3/4" φ Hilti Hit-HY 200 adhesive anchors @ 8.6 in o.c. max. along long side of curb w/ 4" embed

**Longitudinal:** Uplift<sub>MAX</sub> = 3241 lbs Shear<sub>MAX</sub> = 1524 lbs

Compression<sub>SEISMIC</sub> = 901 lbs = [2.5 \* FpmaxASD \* (Hcm + Hcurb) + (1 + 0.14SDS) \* (WGT<sub>unit+curb</sub>/2) \* Lcurb] / Lcurb

Tension<sub>SEISMIC</sub> = 571 lbs = Comp<sub>SEISMIC</sub> - [0.6 - 0.14SDS] \* (WGTunit + curb)

Shear<sub>SEISMIC</sub> = 306 lbs = 2.5 \* FpmaxASD / 2

Min Bolts Req'd Uplift = 3.52 spacing = 5.66667 in o.c. TApplied = 648.3 lbs

Min Bolts Req'd Shear = 2.00 spacing = 17 in o.c. VApplied = 304.8 lbs

Try using 5 bolts spaced at 7.25 in o.c.	COMBINED LOADING = $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 0.98$
--	--

Use 5 - 3/4" φ Hilti Hit-HY 200 adhesive anchors @ 7.3 in o.c. max. along short side of curb w/ 4" embed

<b>CURB DESIGN SUMMARY:</b> CBKD-161			
<b>CURB RAIL THICKNESS:</b> 0.0713 in 14 Gauge			
<b>UNIT CLIP THICKNESS:</b> 0.0713 in 14 Gauge			
<b># OF CLIPS (LONG SIDE)</b> - 1 clips with 4 - #12 SMS screws each clip			
<b>WEB STIFFENER:</b> 16Ga x 3/4" x 7" (C-channel) stiffener at each clip			
<b># OF CLIPS (SHORT SIDE)</b> - 1 clips with 4 - #12 SMS screws each clip			
<b>WEB STIFFENER:</b> 16Ga x 3/4" x 7" (C-channel) stiffener at each clip			
<b>CORNER CONNECTION:</b> Use 3 - 1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts			
<b>CURB ANCHORAGE</b>	<b>WOOD</b>	<b>STEEL</b>	<b>CONCRETE</b>
	5/8" φ lag screw w/ min. 3.5" embed (SGmin=0.43)	5/8" φ A307 bolts	3/4" φ thr'd rod in Hilti HIT-HY 200 epoxy, min. 4" embed
<b>LONG DIRECTION</b>	5 @ 9.63 in o.c.	2 @ 34.5 in o.c.	5 @ 8.63 in o.c.
<b>SHORT DIRECTION</b>	5 @ 8.25 in o.c.	2 @ 29 in o.c.	5 @ 7.25 in o.c.