




# MOUR GROUP

ENGINEERING + DESIGN

## **Wind Calculations for York LX Series (Large Chassis) Rooftop Equipment**

Kit #80-265-50\*\*

2017 Florida Building Code requirements

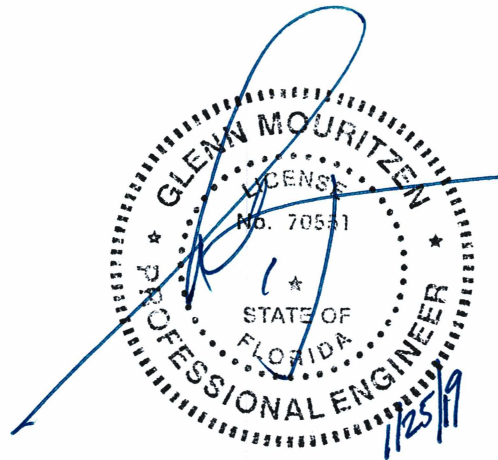


**Prepared for:**

**PROVENT / RRS**  
3847 Wabash Drive  
Mira Loma, CA 91725

**Date: January 25, 2019**  
**Project Number: PV1807**

# STEEL ATTACHMENT


CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 5/8" Ø A307 BOLTS ATTACHED TO STEEL ANGLE BELOW DECK AT EACH CONNECTION POINT.

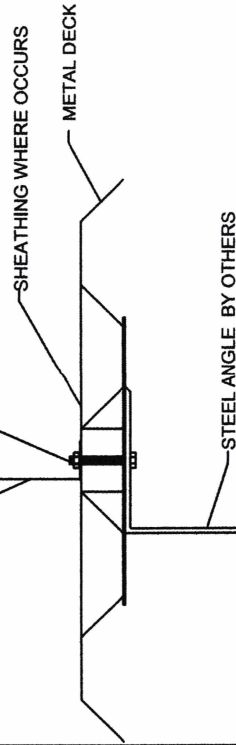

| CURB KIT  | NO. OF ANCHORAGE BOLTS REQUIRED |                | UNIT            |
|-----------|---------------------------------|----------------|-----------------|
|           | LONG SIDE *                     | SHORT SIDE *   |                 |
| 80-265-49 | 2 @ 34.5" o.c.                  | 2 @ 19" o.c.   | LXS             |
| 80-265-50 | 2 @ 34.5" o.c.                  | 2 @ 29" o.c.   | LXL             |
| 80-265-13 | 2 @ 61" o.c.                    | 2 @ 25.3" o.c. | SUNLINE 3-6 TON |
| 80-265-45 | 2 @ 58.4" o.c.                  | 2 @ 28.2" o.c. | PRESTIGE SMALL  |
| 80-265-46 | 2 @ 72" o.c.                    | 2 @ 41" o.c.   | PRESTIGE LARGE  |
| 80-265-29 | 3 @ 34.7" o.c.                  | 2 @ 39.5" o.c. | PREDATOR        |
| 80-265-19 | 3 @ 51.6" o.c.                  | 2 @ 72" o.c.   | SUNLINE ULTRA   |
| 80-265-18 | 4 @ 38.1" o.c.                  | 3 @ 36" o.c.   | SUNLINE MAGNA   |

# WOOD ATTACHMENT

CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 5/8" Ø WOOD LAG SCREWS (3.5" MIN. EMBED. INTO WOOD FRAMING)



| CURB KIT  | NO. OF ANCHORAGE SCREWS REQUIRED |                | UNIT            |
|-----------|----------------------------------|----------------|-----------------|
|           | LONG SIDE                        | SHORT SIDE     |                 |
| 80-265-49 | 5 @ 9.6" o.c.                    | 3 @ 11.5" o.c. | LXS             |
| 80-265-50 | 5 @ 9.6" o.c.                    | 5 @ 8.3" o.c.  | LXL             |
| 80-265-13 | 8 @ 9.3" o.c.                    | 4 @ 9.8" o.c.  | SUNLINE 3-6 TON |
| 80-265-45 | 6 @ 12.5" o.c.                   | 3 @ 16.1" o.c. | PRESTIGE SMALL  |
| 80-265-46 | 6 @ 15.2" o.c.                   | 4 @ 15" o.c.   | PRESTIGE LARGE  |
| 80-265-29 | 14 @ 5.6" o.c.                   | 7 @ 7.3" o.c.  | PREDATOR        |
| 80-265-19 | 15 @ 7.7" o.c.                   | 12 @ 6.9" o.c. | SUNLINE ULTRA   |
| 80-265-18 | 23 @ 5.4" o.c.                   | 14 @ 5.8" o.c. | SUNLINE MAGNA   |

FOUR INCHES FROM EACH CORNER EVENLY SPACED.


# WIND LOAD ROOF ANCHORAGE DETAIL

Meets wind requirements for the following codes:  
FBC 2017  
based on ASCE 7-10.

Wind:

190 mph exposure D category III or IV building, max BLDG height: 60 ft  
Kzt=1.00 max

# CONCRETE ATTACHMENT

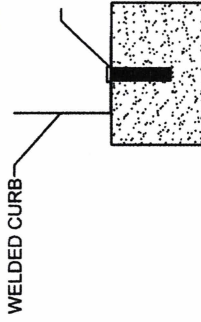


- NORMAL WEIGHT CONC SLAB
- f'c=4000 PSI MIN
- 6" MIN THICK CONC.
- SPECIAL INSPECTION REQUIRED ( ESR-3187)

# NO. OF ANCHORAGE BOLTS REQUIRED

| CURB KIT  | NO. OF ANCHORAGE BOLTS REQUIRED |                 | UNIT            |
|-----------|---------------------------------|-----------------|-----------------|
|           | LONG SIDE *                     | SHORT SIDE **   |                 |
| 80-265-49 | 5 @ 8.6" o.c.                   | 4 @ 6.3" o.c.   | LXS             |
| 80-265-50 | 5 @ 8.6" o.c.                   | 5 @ 7.25" o.c.  | LXL             |
| 80-265-13 | 9 @ 7.63" o.c.                  | 6 @ 5.1" o.c.   | SUNLINE 3-6 TON |
| 80-265-45 | 6 @ 11.7" o.c.                  | 4 @ 9.4" o.c.   | PRESTIGE SMALL  |
| 80-265-46 | 6 @ 14.4" o.c.                  | 5 @ 10.25" o.c. | PRESTIGE LARGE  |
| 80-265-29 | 16 @ 4.63" o.c.                 | 10 @ 4.4" o.c.  | PREDATOR        |
| 80-265-19 | 15 @ 7.4" o.c.                  | 12 @ 6.5" o.c.  | SUNLINE ULTRA   |
| 80-265-18 | 22 @ 5.4" o.c.                  | 17 @ 4.5" o.c.  | SUNLINE MAGNA   |

# STEEL AND CONCRETE ANCHORS ARE 6" FROM EACH CORNER EVENLY SPACED

# CONCRETE OVER METAL DECK

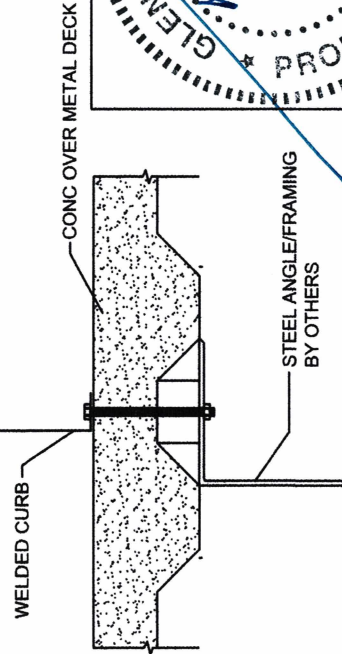

NOTE: FOR CONC OVER METAL DECK OVER STEEL FRAMING USE STEEL ATTACHMENT



SUBMITTED TO:  
COMPANY:  
JOB NAME:  
EQUIPMENT:  
NOTES:

1625 DIPLOMAT DRIVE  
CARROLLTON, TX 75006  
PHONE (972) 247-7447  
FAX (972) 243-0940

FORM NO:  
CB-25A








DATE: 01/07/19  
REV: 1  
DRAWN BY: FMM

**RRS** ROOFTOP SYSTEMS

For wood, concrete and steel attachments see Roof Anchorage Detail, Form No. CB-25A.

Will conform to wind load code requirements for knock-down or pre-assembled application. (Contact factory for assembled version.)

**P\*\*\*B ALL MODELS**

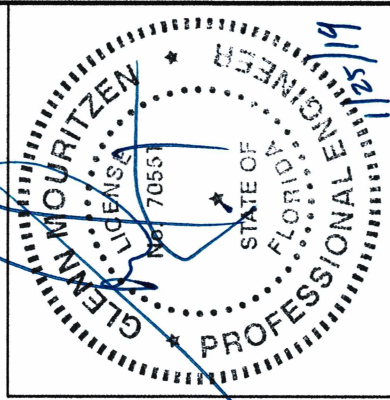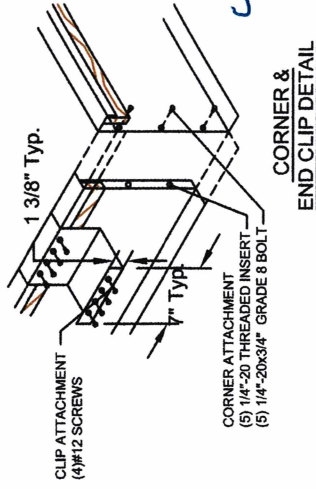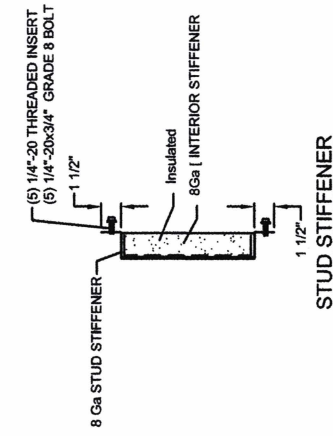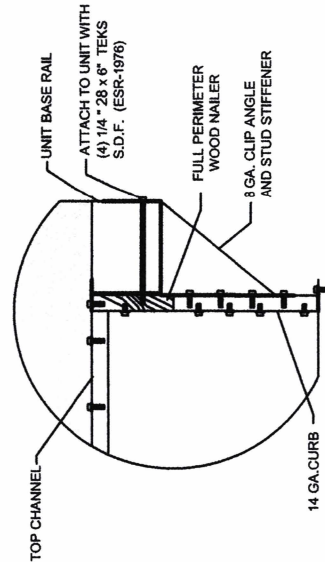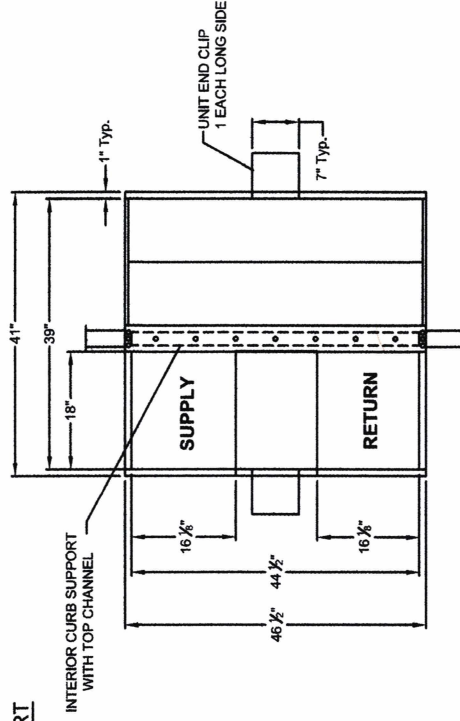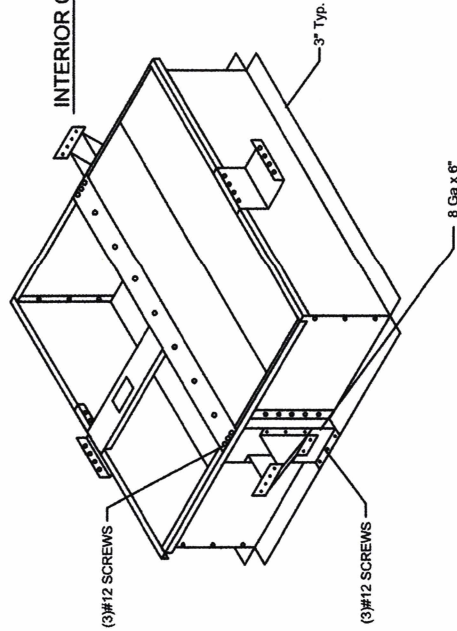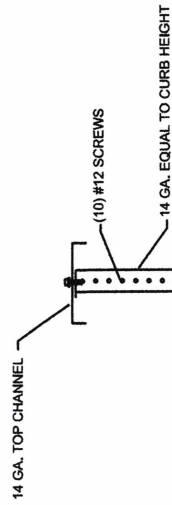

Meets wind requirements for the following codes:  
FBC 2017  
based on ASCE 7-10.  
  
**Wind:**  
190 mph exposure D category III or IV building, max BLDG height: 60 ft  
Kzt=1.00 max

**CALCULATED WIND ROOF CURBS FOR YORK UNITS**

| ProVent P/N | A   | WEIGHT  |
|-------------|-----|---------|
| 80-265-5014 | 14" | 139 Lbs |
| 80-265-5018 | 18" | 163 Lbs |

1625 DIPLOMAT DRIVE  
CARROLTON, TX 75006  
PHONE (972) 247-7447  
FAX (972) 243-0940

SUBMITTED TO:  
COMPANY:  
JOB NAME:  
EQUIPMENT:  
NOTES:

FORM NO:  
CBKD-161A

PART NUMBER:  
80-265-50

DATE:  
01/07/19

REV:  
-

DRAWN BY:  
FMM







# MOUR GROUP

ENGINEERING + DESIGN

6593 Riverdale St.  
San Diego, CA 92120  
(619)727-4800  
Page \_\_\_\_ of \_\_\_\_


Client: ProVent PV1807  
Description: 80-265-50\*\*  
Unit: York LX Series (Large Chassis) Rooftop Equipment

## Curb Information

Hcurb = 18 in (Height of curb)  
Lcurb = 46.5 in (Length of curb)  
wcurb = 41 in (Width of curb)  
WGTcurb = 163 lbs (Weight of curb)

## Unit Information

WGTunit = 420 lbs (Weight of Unit)  
Wtmax = 141 lbs (Maximum corner weight)  
Wtmin = 78 lbs (Minimum corner weight)  
Hunit = 55 in (Height of unit above curb)  
Hcm = 27.5 in (Height to center of mass)  
Lunit = 51.25 in (Length of unit)  
Wunit = 45.75 in (Width of unit)

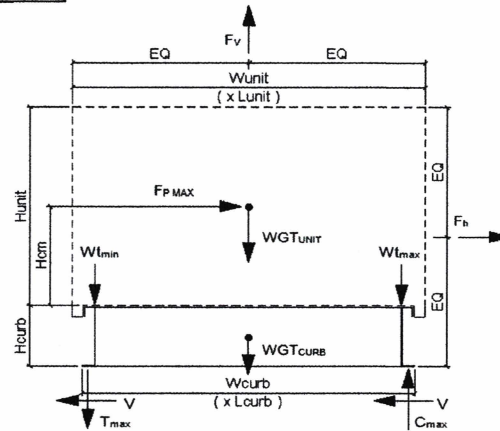

## Seismic Loading - 2017 FBC/2015 IBC

Ss = 0.15 (Worst Case for state of Florida)  
Fa = 2.5 (Worst case Site class E from Table 11.4-1 ASCE 7-10)  
Sms = 0.375 (Fa\*Ss)  
Sds = 0.250 (2/3\*Sms)  
Ip = 1.5 (Importance Factor Category III or IV Building)  
Fpmax = 0.6000 Wp (1.6\*Sds\*Ip)\*Wp  
FpmaxASD = 176 lbs (0.7\*Fpmax)  
FpmaxASD = 245 lbs (unit and curb)

## Wind Loading - 2017 FBC/2015 IBC

\*\*\* Exposure Category D \*\*\*

Kz = 1.31 (For 60 ft roof height, Exposure D - Table 29.3-1 ACSE 7-10)  
Kzt = 1.0 (No topographic effects assumed for rooftop mounted units)  
Kd = 0.85 (Directionality factor Table 26.6-1 ASCE 7-10)  
V = 190 (Wind velocity, mph for Occupancy Cat III-IV bldgs Exp. Cat D)  
GCr(horiz) = 1.9 (Refer Sect 29.5.1 ASCE 7-10)  
GCr(vert) = 1.5 (Refer Sect 29.5.1 ASCE 7-10)  
qz = 102.9 psf = 0.00256\*Kz\*Kzt\*Kd\*V<sup>2</sup> (Eq. 29.3-1 ASCE 7-10)  
Fh ASD trans = 3048 lbs = 0.6\*qz\*GCr\*Lunit\*(Hunit+Hcurb) (Eq. 29.5-2)  
Fh ASD long = 2721 lbs = 0.6\*qz\*GCr\*Wunit\*(Hunit+Hcurb)  
Fvert ASD = 1508 lbs = 0.6\*qz\*GCr\*Lunit\*Wunit (Eq. 29.5-3)

## Curb Loading

### Transverse:

Compression<sub>SEISMIC</sub> = 410 lbs = [FpmaxASD\*Hcm+2\*(1+0.14S<sub>DS</sub>)\*Wtmax\*wcurb]/wcurb  
Tension<sub>SEISMIC</sub> = 173 lbs = Comp<sub>SEISMIC</sub>-(0.6-0.14S<sub>DS</sub>)\*WGTunit  
Compression<sub>WIND</sub> = 1460 lbs = [F<sub>h trans ASD</sub>\*Hcm+2\*0.6\*Wtmax\*wcurb-F<sub>vert ASD</sub>\*wcurb/2]/wcurb  
Tension<sub>WIND</sub> = 2716 lbs = Comp<sub>WIND</sub>+Fvert-0.6\*WGTunit

---> Negative values indicate Compression load rather than Tension.

### Longitudinal:

Compression<sub>SEISMIC</sub> = 396 lbs = [FpmaxASD\*Hcm+2\*(1+0.14\*S<sub>DS</sub>)\*Wtmax\*Lcurb]/Lcurb  
Tension<sub>SEISMIC</sub> = 159 lbs = Comp<sub>SEISMIC</sub>-(0.6-0.14S<sub>DS</sub>)\*WGTunit  
Compression<sub>WIND</sub> = 1024 lbs = [F<sub>h trans ASD</sub>\*Hcm+2\*0.6\*Wtmax\*Lcurb-F<sub>vert ASD</sub>\*Lcurb/2]/Lcurb  
Tension<sub>WIND</sub> = 2280 lbs = Comp<sub>WIND</sub>+Fvert-0.6\*WGTunit

---> Negative values indicate Compression load rather than Tension.

## Governing Reactions:

|                 |                                |                                |
|-----------------|--------------------------------|--------------------------------|
| Transverse:     | Comp <sub>MAX</sub> = 1460 lbs | ---> Along long edge of curb.  |
| (on long edge)  | Tens <sub>MAX</sub> = 2716 lbs | ---> Along long edge of curb.  |
| Longitudinal:   | Comp <sub>MAX</sub> = 1024 lbs | ---> Along short edge of curb. |
| (on short edge) | Tens <sub>MAX</sub> = 2280 lbs | ---> Along short edge of curb. |

---> Negative values indicate Compression load rather than Tension.




## Curb Design

F<sub>y</sub> = 50 ksi      F<sub>u</sub> = 65 ksi      t = 0.0713 **14 Gauge**  
E = 29500 ksi

### Calculate Section Properties of Curb

|                                                             |                                      |
|-------------------------------------------------------------|--------------------------------------|
| A' = 18.000 in                                              | a = 17.644 in = A' - (2r+t)          |
| B' = 2.000 in                                               | a' = 17.929 in = A' - t              |
| C' = 0.000 in (0 if no lips)                                | b = 1.822 in = B' - [r+t/2+α(r+t/2)] |
| α = 0.000 (0 - no Lip; 1 w/ lip)                            | b' = 1.964 in = B' - [t/2+αt/2]      |
| R = 0.1069 (Inside bend radius)                             | c = 0.000 in = α[C' - (r+t/2)]       |
| t = 0.0713 in                                               | c' = 0.000 in = α[C' - t/2]          |
| r' = 0.143 in = R+t/2                                       | u = 0.224 in = πr/2                  |
| x = 0.178 in (Distance between centroid and web centerline) |                                      |
| I <sub>x</sub> = 56.073 in (Moment of Inertia about X-Axis) |                                      |
| I <sub>y</sub> = 0.311 in (Moment of Inertia about Y-Axis)  |                                      |
| A = 1.55 in <sup>2</sup>                                    |                                      |
| r <sub>x</sub> = 6.02 in                                    |                                      |
| r <sub>y</sub> = 0.448 in                                   |                                      |
| r <sub>min</sub> = 0.448 in                                 |                                      |

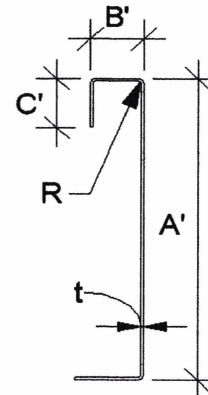

### Axial Compression

|                                                    |                  |                       |
|----------------------------------------------------|------------------|-----------------------|
| P <sub>u</sub> = 1.524 k                           | (Max Axial Comp) | Ω <sub>c</sub> = 1.80 |
| P <sub>n</sub> /Ω <sub>c</sub> = 24.287 k          |                  |                       |
| F <sub>e</sub> = 36.56 ksi                         |                  |                       |
| λ <sub>c</sub> = 1.17                              |                  |                       |
| F <sub>n</sub> = 28.21 ksi                         |                  |                       |
| L <sub>y</sub> = 50 in                             |                  |                       |
| k <sub>y</sub> L <sub>y</sub> /r <sub>y</sub> = 89 |                  |                       |

Lateral unbraced length (assume k=0.8)

Compression Check = **O.K.**

### Check Web Crippling

|                                                      |                                        |                                                                                                                                                    |                                                                      |
|------------------------------------------------------|----------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------|----------------------------------------------------------------------|
| h = 18 in                                            | -- Check limits:                       | C = 4.00                                                                                                                                           | } (See table C3.4.1-2, fastened to support, one flange, end loading) |
| t = 0.0713 in                                        | h/t = 252.45 ≤ 200                     | C <sub>R</sub> = 0.14                                                                                                                              |                                                                      |
| N = 7.00                                             | N/t = 98.18 ≤ 210                      | C <sub>N</sub> = 0.35                                                                                                                              |                                                                      |
| Ω <sub>w</sub> = 1.75                                | N/h = 0.388889 ≤ 2.0                   | C <sub>h</sub> = 0.02                                                                                                                              |                                                                      |
| P <sub>n</sub> = 2.296 k                             | R/t = 1.50 ≤ 9.0                       |                                                                                                                                                    |                                                                      |
| P <sub>n</sub> /Ω <sub>w</sub> = 1.312 k             |                                        |                                                                                                                                                    |                                                                      |
| Long side: P <sub>u</sub> <sub>trans</sub> = 1.460 k | <b>web stiffener REQ'D</b> # clips = 1 | $P_n = C t^2 F_y \sin(90) \left(1 - C_R \sqrt{\frac{R}{t}}\right) \left(1 + C_N \sqrt{\frac{N}{t}}\right) \left(1 - C_h \sqrt{\frac{h}{t}}\right)$ |                                                                      |
| Short side: P <sub>u</sub> <sub>Long</sub> = 1.024 k | <b>O.K.</b> # clips = 1                |                                                                                                                                                    |                                                                      |

\*\*\*h/t > 200; use web stiffeners

### Check Web Stiffener

16Ga x 3/4" x 7" (C-channel)

|                                                                                          |                                         |
|------------------------------------------------------------------------------------------|-----------------------------------------|
| width of stiffener = 7.000 in                                                            | t <sub>s</sub> = 0.0566 <b>16 Gauge</b> |
| web of stiff. w = 6.717 in                                                               | R <sub>s</sub> = 0.0849 in              |
| ***Check w/ts ≤ 1.28√E/F <sub>y</sub>                                                    | Ω <sub>c</sub> = 1.70                   |
| w/ts = 118.675                                                                           |                                         |
| 1.28√E/F <sub>y</sub> = 31.091                                                           | --> w/ts over limit Use C3.7.2          |
| P <sub>n</sub> = 0.7(P <sub>wc</sub> + A <sub>e</sub> F <sub>y</sub> ) ≥ P <sub>wc</sub> |                                         |
| P <sub>wc</sub> = 2.296 k                                                                | A <sub>e</sub> = 0.380 in <sup>2</sup>  |
| P <sub>n</sub> = 14.913 k                                                                | P <sub>n</sub> /Ω = 8.773 k             |

**O.K.**

### Corner Connections

1/4" φ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts

|                                                             |                                                                                |
|-------------------------------------------------------------|--------------------------------------------------------------------------------|
| T <sub>crn</sub> max = 762 lbs                              | Max(F <sub>pmaxASD</sub> /4 -OR- F <sub>hASDtrans</sub> /4 corner connections) |
| V <sub>crn</sub> max = 1358 lbs                             | (Max Ten/2 corner connections per side)                                        |
| Bolt: Tall = 2480 lbs                                       | Vall = 1096 lbs                                                                |
| Threaded Insert: Tall = 2860 lbs                            | Vall = 1714 lbs                                                                |
| # of Bolts required for Tension = 0.3                       |                                                                                |
| # of Bolts required for Shear = 1.2                         |                                                                                |
| # of Bolts Used = 2.0                                       |                                                                                |
| Check Combined Stress in Bolts & Inserts: 0.773 <b>O.K.</b> | StressComb = 0.515 <b>O.K.</b>                                                 |

\*\*\*If combined fails: USE --> 3.0

### Check 1/8" welded connection

<--- USE WELD      Ω = 2.35

|                                  |                                                                  |                                                          |
|----------------------------------|------------------------------------------------------------------|----------------------------------------------------------|
| Assume L/t > 25: 25*t = 1.783 in | P <sub>n</sub> /Ω = $\frac{1}{\Omega} 0.75 t L F_u \geq V_{req}$ | L <sub>req'd</sub> = $\frac{V_{req} \Omega}{0.75 t F_u}$ |
| L <sub>req'd</sub> = 0.918 in    |                                                                  |                                                          |



# MOUR GROUP

ENGINEERING + DESIGN

6593 Riverdale St.  
San Diego, CA 92120  
(619) 727-4800  
Page \_\_\_ of \_\_\_

## Connection Unit to Curb Clip

#12 SMS screw

$\Omega = 3.0$

$t_1 = 0.0713$  in

$F_{u1} = 65$  ksi

$t_2 = 0.1017$  in (unit base rail thickness)

$F_{u2} = 65$  ksi

$d = 0.216$  in (screw diameter)

$d_w = 0.375$  in (nom. washer diameter)

$t_2/t_1 = 1.4$

For  $t_2/t_1 \leq 1.0$ :

$P_{ns} = 2703$  #

For  $t_2/t_1 \geq 2.5$ :

$P_{ns} = 2703$  #

Shear:

$P_{ns} = 4.2F_{u2}\sqrt{t_2^3/d}$

4.12 k

$P_{ns} = 2.7t_1dF_{u1}$

2.70 k

$P_{ns} = 2.7t_2dF_{u2}$

3.86 k

$P_{ns} = 2.7t_2dF_{u2}$

3.86 k

$P_{ns}/\Omega = 901$  #

$P_{ss}/\Omega = 840$  # <- Controls

$P_{not} = 0.85t_c d F_{u2}$

$t_c = \min(t_1, t_2)$

Tension:

$P_{not} = 1.214$  k (screw pull-out strength)

$P_{nov} = 2.607$  k (screw pull-over strength)

$P_{nov} = 1.5t_1 d_w F_{u1}$

$P_{ts}/\Omega = 405$  # <- Controls

$P_{ts}/\Omega = 845$  #

(full tensile screw capacity)

|             | Shear (k) | # clips | $V_{clip}$ (k) | $V_{allow}$ (lb) | # screws | spacing |
|-------------|-----------|---------|----------------|------------------|----------|---------|
| Long side:  | 3.048     | 1       | 3.05           | 840 #            | 4        | 2.00 in |
| Short side: | 2.721     | 1       | 2.72           | 840 #            | 4        | 2.00 in |

clip width (in) = 7.00

clip height = 2.5 in

min spacing = 0.65 in

edge distance = 0.5 in (min. 1.5d)

Check Block shear rupture: O.K.

thinnest part = 0.0713 AISI BSR applies

$F_y = 50$  ksi

$\Omega = 2.22$  bolt/screw connection

$A_{gv} = 0.463$  in<sup>2</sup>

$A_{nv} = 0.410$  in<sup>2</sup>


$A_{nt} = 0.081$  in<sup>2</sup>

$R_n/\Omega = 8.647$  k

$R_n = 0.6F_y A_{gv} + F_u A_{nt} \leq 0.6F_u A_{nv} + F_u A_{nt}$

[AISI Sect. E5.3]

BSR O.K.

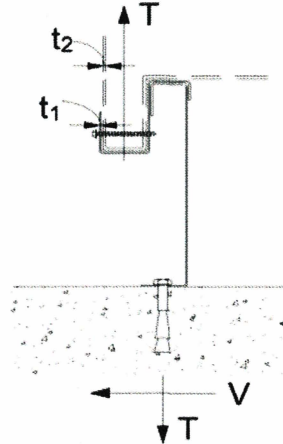

## Connection of Curb to Supporting Structure

Roof Loading

SEISMIC: (0.6-0.14SDS)D + 0.7E

WIND: 0.6D + W

| Transverse:                    | Uplift <sub>MAX</sub> | 3961 lbs                                                                                                               | Shear <sub>MAX</sub> | 1524 lbs |
|--------------------------------|-----------------------|------------------------------------------------------------------------------------------------------------------------|----------------------|----------|
| Compression <sub>SEISMIC</sub> | 573 lbs               | $= [F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{ps}) * (WGT_{unit+curb}/2) * w_{curb}] / w_{curb}$                 |                      |          |
| Tension <sub>SEISMIC</sub>     | 244 lbs               | $= Comp_{SEISMIC} - (0.6 - 0.14S_{ps}) * (WGT_{unit+curb})$                                                            |                      |          |
| Compression <sub>WIND</sub>    | 2803 lbs              | $= [F_{htransASD} * (H_{cm} + H_{curb}) + 0.6 * (WGT_{unit+curb}/2) * w_{curb} - F_{vertASD} * w_{curb}/2] / w_{curb}$ |                      |          |
| Tension <sub>WIND</sub>        | 3961 lbs              | $= [F_{htransASD} * (H_{cm} + H_{curb}) - 0.6 * (WGT_{unit+curb}/2) * w_{curb} + F_{vertASD} * w_{curb}/2] / w_{curb}$ |                      |          |
| Longitudinal:                  | Uplift <sub>MAX</sub> | 3241 lbs                                                                                                               | Shear <sub>MAX</sub> | 1360 lbs |
| Compression <sub>SEISMIC</sub> | 541 lbs               | $= [F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14S_{ps}) * (WGT_{unit+curb}/2) * L_{curb}] / L_{curb}$                 |                      |          |
| Tension <sub>SEISMIC</sub>     | 212 lbs               | $= Comp_{SEISMIC} - (0.6 - 0.14S_{ps}) * (WGT_{unit+curb})$                                                            |                      |          |
| Compression <sub>WIND</sub>    | 2083 lbs              | $= [F_{htransASD} * (H_{cm} + H_{curb}) + 0.6 * (WGT_{unit+curb}/2) * L_{curb} - F_{vertASD} * L_{curb}/2] / L_{curb}$ |                      |          |
| Tension <sub>WIND</sub>        | 3241 lbs              | $= [F_{htransASD} * (H_{cm} + H_{curb}) - 0.6 * (WGT_{unit+curb}/2) * L_{curb} + F_{vertASD} * L_{curb}/2] / L_{curb}$ |                      |          |

Wood Attachment:

Use 5/8"  $\phi$  wood lag screws w/ 3.5" Min. Embed

$T_{all,metal} = 946.67$  lbs

$V_{all,metal} = 1043.33$  lbs

Transverse:

$T_{all,wood} = 1195.95$  lbs

$V_{all,wood} = 1024$  lbs

# of Screws Req'd for Uplift = 4.18

COMBINED LOADING: 0.960 O.K.

# of Screws Req'd for Shear = 1.49

Screw Spacing = 9.6 in o.c.

Total # of screws Required = 5

Use 5/8"  $\phi$  wood lag screws @ 9.6 in o.c. along long side of curb w/ 3.5" Min. Embed

Longitudinal:

# of Screws Req'd for Uplift = 3.4

COMBINED LOADING: 0.808 O.K.

# of Screws Req'd for Shear = 1.3

Screw Spacing = 8.3 in o.c.

Total # of screws Required = 5

Use 5/8"  $\phi$  wood lag screws @ 8.3 in o.c. along short side of curb w/ 3.5" Min. Embed

Steel Deck Attachment:

Use 5/8"  $\phi$  A307 Bolts attached to steel angle below deck

$T_{all,bolt} = 6903$  lbs

$V_{all,bolt} = 3682$  lbs

Transverse:

$T_{all,bolt} = 6903$  lbs

$V_{all,bolt} = 3682$  lbs

# of Bolts Req'd for Uplift = 0.57

COMBINED LOADING: 0.197 O.K.

# of Bolts Req'd for Shear = 0.41

Bolt Spacing = 34.5 in o.c.

Total # of Bolts Required = 2

Use 5/8"  $\phi$  A307 Bolts attached to steel angle below deck @ 34.5 in o.c. along long side of curb

Longitudinal:

# of Bolts Req'd for Uplift = 0.47

COMBINED LOADING: 0.149 O.K.

# of Bolts Req'd for Shear = 0.37

Req'd Min Spacing = 29.0 in o.c.

Total # of Bolts Required = 2

Use 5/8"  $\phi$  A307 Bolts attached to steel angle below deck @ 29 in o.c. along short side of curb





# MOUR GROUP

ENGINEERING + DESIGN

6593 Riverdale St.

San Diego, CA 92120

(619)727-4800

Page \_\_\_\_ of \_\_\_\_

For Concrete anchorage: SEISMIC  $(0.6-0.14SDS)D + 0.7\Omega_o E$  ( $\Omega_o = 2.5$ )

Concrete Attachment: 3/4"  $\phi$  Hilti Hit-HY 200 adhesive anchors w/ 4" embed

Tall<sub>LRFD</sub> = 1722 lbs Vall<sub>LRFD</sub> = 2032 lbs  $\alpha = (1 + 0.2SDS)D + 2.5E = 1.87$

Tall<sub>ASD</sub> = Tall<sub>LRFD</sub>/ $\alpha$  = 920.9 lbs Vall<sub>ASD</sub> = Vall<sub>LRFD</sub>/ $\alpha$  = 1086.6 lbs ( $D = 0.465, E = 0.535$ )

Transverse: Uplift<sub>MAX</sub> = 3961 lbs Shear<sub>MAX</sub> = 1524 lbs

Compression<sub>SEISMIC</sub> = 981 lbs =  $[2.5 * F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14SDS) * (WGT_{unit+curb}/2) * w_{curb}] / w_{curb}$

Tension<sub>SEISMIC</sub> = 652 lbs =  $Comp_{SEISMIC} - [0.6 - 0.14SDS] * [WGT_{unit+curb}]$

Shear<sub>SEISMIC</sub> = 306 lbs =  $2.5 * F_{pmaxASD} / 2$

Min Bolts Req'd Uplift = 4.30 spacing = 5.63 in o.c. T<sub>applied</sub> = 792.3 lbs

Min Bolts Req'd Shear = 2.00 spacing = 22.5 in o.c. V<sub>applied</sub> = 304.8 lbs

Try using 5 bolts  
spaced at 8.63 in o.c.

COMBINED LOADING =  $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 1.14$

Use 5 - 3/4"  $\phi$  Hilti Hit-HY 200 adhesive anchors @ 8.6 in o.c. max. along long side of curb w/ 4" embed

Longitudinal: Uplift<sub>MAX</sub> = 3241 lbs Shear<sub>MAX</sub> = 1524 lbs

Compression<sub>SEISMIC</sub> = 901 lbs =  $[2.5 * F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.14SDS) * (WGT_{unit+curb}/2) * L_{curb}] / L_{curb}$

Tension<sub>SEISMIC</sub> = 571 lbs =  $Comp_{SEISMIC} - [0.6 - 0.14SDS] * [WGT_{unit+curb}]$

Shear<sub>SEISMIC</sub> = 306 lbs =  $2.5 * F_{pmaxASD} / 2$

Min Bolts Req'd Uplift = 3.52 spacing = 5.666667 in o.c. T<sub>applied</sub> = 648.3 lbs

Min Bolts Req'd Shear = 2.00 spacing = 17 in o.c. V<sub>applied</sub> = 304.8 lbs

Try using 5 bolts  
spaced at 7.25 in o.c.

COMBINED LOADING =  $\frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 0.98$

Use 5 - 3/4"  $\phi$  Hilti Hit-HY 200 adhesive anchors @ 7.3 in o.c. max. along short side of curb w/ 4" embed

| CURB DESIGN SUMMARY: 80-265-50**                                                        |                                                       |                        |                                                                 |
|-----------------------------------------------------------------------------------------|-------------------------------------------------------|------------------------|-----------------------------------------------------------------|
| CURB RAIL THICKNESS: 0.0713 in 14 Gauge                                                 |                                                       |                        |                                                                 |
| UNIT CLIP THICKNESS: 0.0713 in 14 Gauge                                                 |                                                       |                        |                                                                 |
| # OF CLIPS (LONG SIDE) - 1 clips with 4 - #12 SMS screws each clip                      |                                                       |                        |                                                                 |
| WEB STIFFENER: 16Ga x 3/4" x 7" (C-channel) stiffener at each clip                      |                                                       |                        |                                                                 |
| # OF CLIPS (SHORT SIDE) - 1 clips with 4 - #12 SMS screws each clip                     |                                                       |                        |                                                                 |
| WEB STIFFENER: 16Ga x 3/4" x 7" (C-channel) stiffener at each clip                      |                                                       |                        |                                                                 |
| CORNER CONNECTION: Use 3 - 1/4" $\phi$ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts |                                                       |                        |                                                                 |
| CURB ANCHORAGE                                                                          | WOOD                                                  | STEEL                  | CONCRETE                                                        |
|                                                                                         | 5/8" $\phi$ lag screw w/ min. 3.5" embed (SGmin=0.43) | 5/8" $\phi$ A307 bolts | 3/4" $\phi$ thrd'd rod in Hilti HIT-HY 200 epoxy, min. 4" embed |
| LONG DIRECTION                                                                          | 5 @ 9.63 in o.c.                                      | 2 @ 34.5 in o.c.       | 5 @ 8.63 in o.c.                                                |
| SHORT DIRECTION                                                                         | 5 @ 8.25 in o.c.                                      | 2 @ 29 in o.c.         | 5 @ 7.25 in o.c.                                                |