



MOUR GROUP
ENGINEERING + DESIGN

6593 Riverdale St.
San Diego, CA 92120
619-727-4800

**Structural Calculations
for
CBWC-114 Series**



Prepared for:
PROVENT / RRS
3847 Wabash Drive
Mira Loma, CA 91725

Date: July 29, 2019
Project Number: PV1806

For wood, concrete and steel attachments see Roof Anchorage Detail, Form No. CB-60.

FEATURES

- Roof curb sides and ends are 16 ga. galvanized steel.
- Gasketing package provided.
- Heat treated wood nailer provided.
- Pitched curbs and taller curbs are available.

NOTES




- Attach ductwork to roof curb. Flanges of duct rest on top of curb. Support ductwork below the curb.

STRUCTURALLY CALCULATED WELDED ROOF CURBS FOR YORK UNITS


ZF 180

ProVent P/N	A	WEIGHT
CBWCSLU18008	8"	152 Lbs
CBWCSLU18011	11"	177 Lbs
CBWCSLU18014	14"	202 Lbs
CBWCSLU18024	24"	354 Lbs


Meets seismic requirements for the following codes:
CBC 2016
IBC 2015

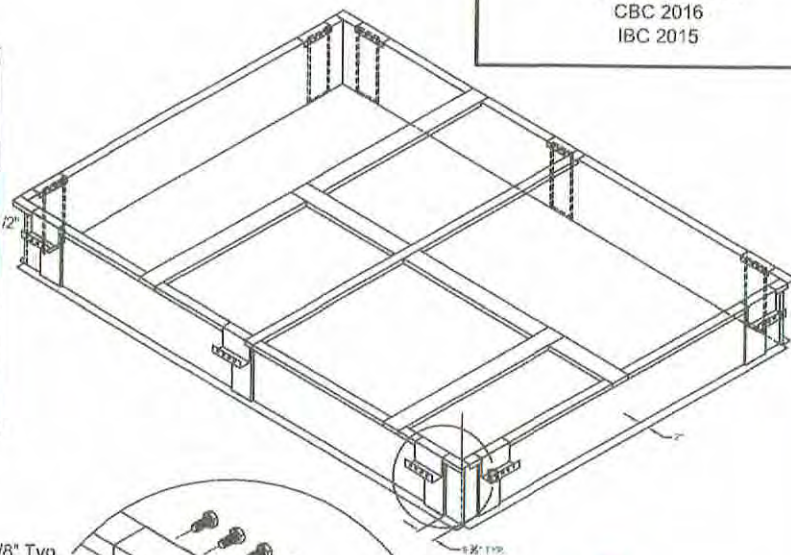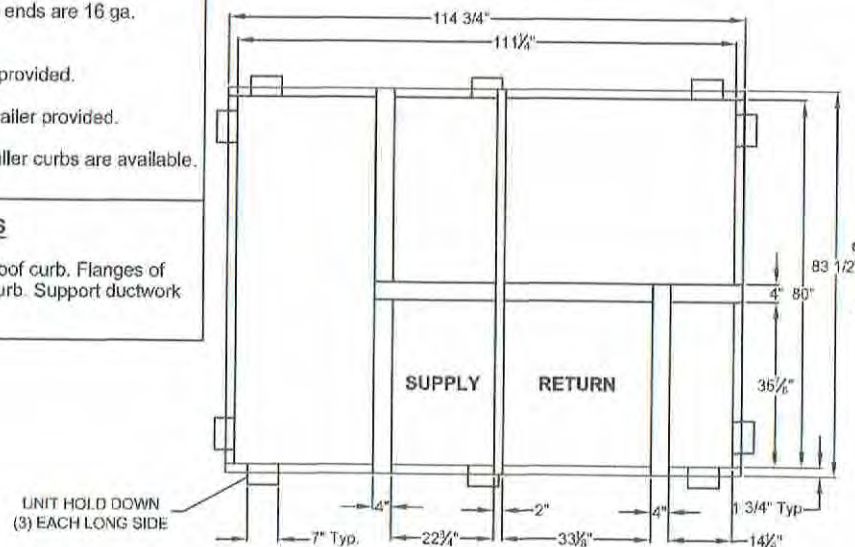


CURB DETAIL

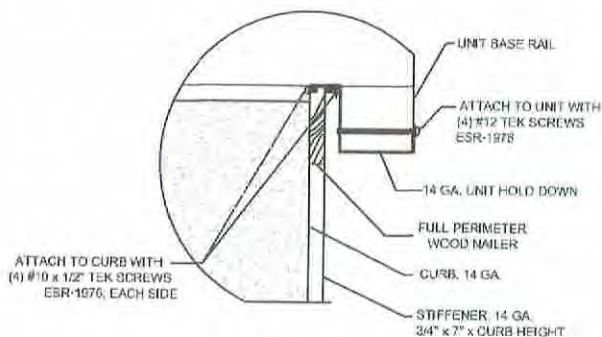

HOLD DOWN DETAIL

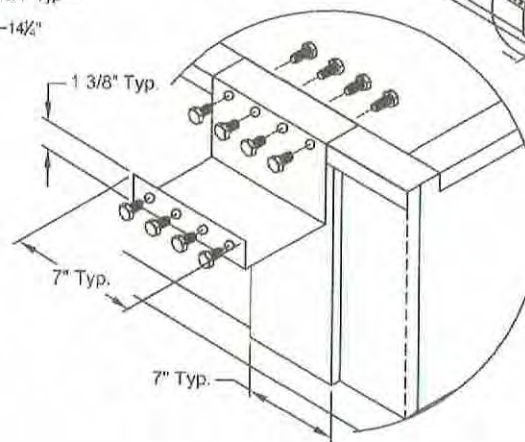

DETAIL B

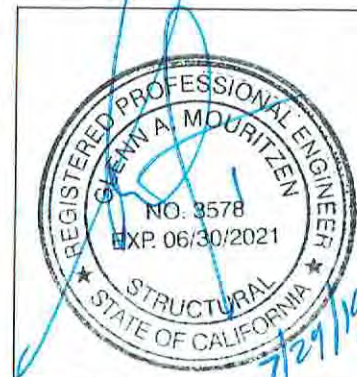

3847 WABASH DRIVE
MIRA LOMA, CA 91725

PHONE (951) 685-1101
FAX (619) 872-9799

SUBMITTED TO: _____
COMPANY: _____
JOB NAME: _____
EQUIPMENT: _____
NOTES: _____

FORM NO:
CBWC-114


DATE:
09/27/18

REV:
5

PART NUMBER:
CBWCSLU180 SERIES

DRAWN BY:
ALL

STEEL ATTACHMENT

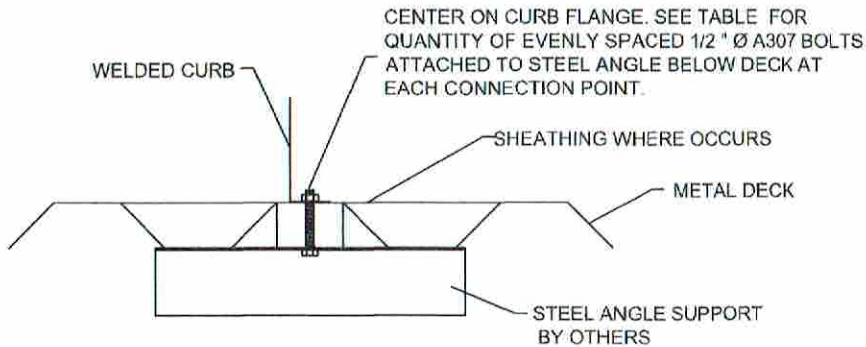

NO. OF ANCHORAGE BOLTS REQUIRED		
CURB	LONG SIDE	SHORT SIDE
LXS	2 @ 34.5" O.C	XX @ 2 @ 19" O.C
LXL	2 @ 34.5" O.C.XX	2 @ 29" O.C
SUN3672	2 @ 60" O.C	2 @ 24.25" O.C
PRD3715	2 @ 68.38" O.C	2 @ 38.5" O.C
PRS	2 @ 58.38" O.C	2 @ 28.19" O.C.
PRL	2 @ 72" O.C	2 @ 41" O.C
SLU180	2 @ 102.25" O.C.	2 @ 71" O.C.
SLM1830	2 @ 113.25" O.C	2 @ 71" O.C.

* SIX INCHES FROM EACH CORNER EVENLY SPACED.
** CENTERED.


Meets seismic requirements for the following codes:
CBC 2016
IBC 2015

ASSUMES:
CONC SLAB
 $f_c = 4000$ PSI MINIMUM
6" MIN THICKNESS
NORMAL WEIGHT CONCRETE
OR SAND LIGHT WEIGHT

CONCRETE ATTACHMENT


WELDED CURB

CENTER ON CURB FLANGE. SEE TABLE FOR QUANTITY OF EVENLY SPACED 3/4" Ø THREADED ROD IN HILTI HIT-HY 200 EPOXY WITH 4" EMBED



NO. OF ANCHORAGE BOLTS REQUIRED		
CURB	LONG SIDE	SHORT SIDE
LXS	10 @ 3.73" O.C.	9 @ 2.38" O.C.
LXL	8 @ 4.93" O.C.	7 @ 4.83" O.C.
SUN3672	9 @ 7.5" O.C.	6 @ 4.85" O.C.
PRD3715	17 @ 4.27" O.C.	13 @ 3.21" O.C.
PRS	9 @ 7.3" O.C.	7 @ 4.7" O.C.
PRL	11 @ 7.2" O.C.	9 @ 5.13" O.C.
SLU180	16 @ 6.82" O.C.	13 @ 5.92" O.C.
SLM1830	18 @ 6.66" O.C.	13 @ 5.92" O.C.

WOOD ATTACHMENT

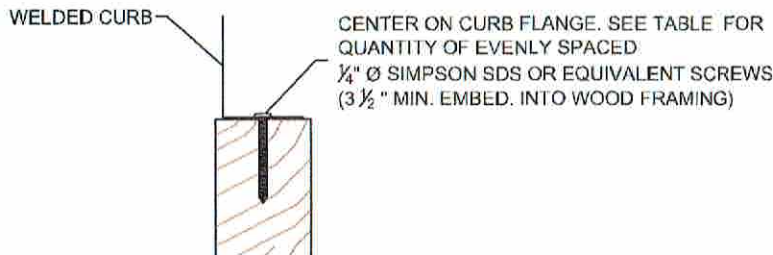

NO. OF ANCHORAGE SCREWS REQUIRED		
CURB	LONG SIDE	SHORT SIDE
LXS	7 @ 6.42" O.C.	4 @ 7.67" O.C.
LXL	7 @ 6.42" O.C.	6 @ 6.6" O.C.
SUN3672	4 @ 21.33" O.C.	3 @ 14.13" O.C.
PRD3715	8 @ 10.34" O.C.	6 @ 8.5" O.C.
PRS	4 @ 20.79" O.C.	3 @ 16.09" O.C.
PRL	4 @ 25.33" O.C.	3 @ 22.5" O.C.
SLU180	7 @ 17.71" O.C.	7 @ 12.5" O.C.
SLM1830	8 @ 16.75" O.C.	6 @ 15" O.C.

FOUR INCHES FROM EACH CORNER EVENLY SPACED



3847 WABASH DRIVE
MIRA LOMA, CA 91725

PHONE (951) 685-1101
FAX (619) 872-9799

SUBMITTED TO: _____
COMPANY: _____
JOB NAME: _____
EQUIPMENT: _____
NOTES: _____

FORM NO:
CB-60

DATE:
07/31/18

REV:
3

DRAWN BY:
ALL




Client: ProVent PV1806
Description: CBWC-114 (CBWCSLU180**)
Unit: ZF 180

Curb Information

Hcurb = 24 in (Height of curb)
Lcurb = 114.25 in (Length of curb)
wcurb = 83 in (Width of curb)
WGTcurb = 354 lbs (Weight of curb)
Clips long side = 3 # Clips short side = 2

Unit Information

WGTunit = 2057 lbs (Weight of Unit)
Wtmax = 498 lbs (Maximum corner weight)
Wtmin = 438 lbs (Minimum corner weight)
Hunit = 48.625 in (Height of unit above curb)
Hcm = 24.3125 in (Height to center of mass)
Lunit = 125.25 in (Length of unit)
Wunit = 92 in (Width of unit)

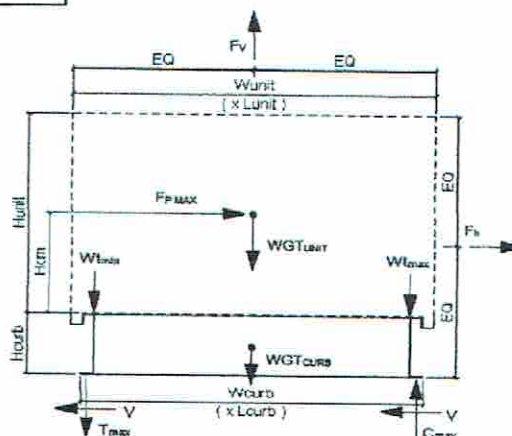

Seismic Loading - 2015 IBC/2016 CBC

Ss = 2.85 (Worst case for majority of CA - Design Category U)
Fa = 1 (Interpolated from Table 11.4-1 ASCE 7-10)
Sms = 2.850 (Fa*Ss)
Sds = 1.900 (2/3*Sms)
Ip = 1.25 (Importance Factor Category III Building)
Fpmax = 3.800 Wp (1.6*Sds*Ip)*Wp
FpmaxASD = 5472 lbs (0.7*Fpmax)
FpmaxASD = 6413 lbs (unit and curb)

Wind Loading - 2015 IBC/2016 CBC

*** Exposure Category C ***

Kz = 1.13 (For 60 ft roof height, Exposure C - Table 29.3-1 ASCE 7-10)
Kzt = 1.0 (No topographic effects assumed for rooftop mounted units)
Kd = 0.85 (Directionality factor Table 26.6-1 ASCE 7-10)
V = 115 (Max wind velocity, mph for Cat III & IV bldgs Exp. Cat C)
GCr(horiz) = 1.9 (Refer Sect 29.5.1 ASCE 7-10)
GCr(vert) = 1.5 (Refer Sect 29.5.1 ASCE 7-10)
qz = 32.5 psf = 0.00256*Kz*Kzt*Kd*V² [Eq. 29.3-1 ASCE 7-10]
Fh ASD trans = 2342 lbs = 0.6*qz*GCr*Lunit*(Hunit+Hcurb) [Eq. 29.5-2]
Fh ASD long = 1720 lbs = 0.6*qz*GCr*Wunit*(Hunit+Hcurb)
Fvert ASD = 2342 lbs = 0.6*qz*GCr*Lunit*Wunit [Eq. 29.5-3]

Curb Loading

Transverse:

Compression_{SEISMIC} = 2864 lbs = [FpmaxASD*Hcm+2*(1+0.14S_{DS})*Wtmax*wcurb]/wcurb
Tension_{SEISMIC} = 2177 lbs = Comp_{SEISMIC}-(0.6-0.14S_{DS})*WGTunit
Compression_{WIND} = 113 lbs = [Fh trans ASD*Hcm+2*0.6*Wtmax*wcurb-Fvert ASD*wcurb/2]/wcurb
Tension_{WIND} = 1220 lbs = Comp_{WIND}+Fvert-0.6*WGTunit

---> Negative values indicate Compression load rather than Tension.

Longitudinal:

Compression_{SEISMIC} = 2425 lbs = [FpmaxASD*Hcm+2*(1+0.14S_{DS})*Wtmax*Lcurb]/Lcurb
Tension_{SEISMIC} = 1738 lbs = Comp_{SEISMIC}-(0.6-0.14S_{DS})*WGTunit
Compression_{WIND} = -207 lbs = [Fh trans ASD*Hcm+2*0.6*Wtmax*Lcurb-Fvert ASD*Lcurb/2]/Lcurb
Tension_{WIND} = 900 lbs = Comp_{WIND}+Fvert-0.6*WGTunit

---> Negative values indicate Compression load rather than Tension.

Governing Reactions:

Transverse:	Comp _{MAX} = 2864 lbs	---> Along long edge of curb.
(on long edge)	Tens _{MAX} = 2177 lbs	---> Along long edge of curb.
Longitudinal:	Comp _{MAX} = 2425 lbs	---> Along short edge of curb.
(on short edge)	Tens _{MAX} = 1738 lbs	---> Along short edge of curb.

---> Negative values indicate Compression load rather than Tension.




Curb Design

$F_y = 50$ ksi $F_u = 65$ ksi $t = 0.0566$ 16 Gauge
 $E = 29500$ ksi

Calculate Section Properties of Curb

$A' = 24.000$ in $a = 23.717$ in $= A' - (2r + t)$
 $B' = 3.000$ in $a' = 23.943$ in $= A' - t$
 $C' = 1.000$ in [0 if no lips] $b = 2.717$ in $= B' - (r + t/2 + a(r + t/2))$
 $a = 1.000$ in [0 - no Lip; 1 w/ Lip] $b' = 2.943$ in $= B' - (t/2 + at/2)$
 $R = 0.0849$ in [Inside bend radius] $c = 0.859$ in $= a[C' - (r + t/2)]$
 $t = 0.0566$ in $c' = 0.972$ in $= a[C' - t/2]$
 $r' = 0.113$ in $= R + t/2$ $u = 0.178$ in $= \pi r/2$
 $x = 0.446$ in [Distance between centroid and web centerline]
 $I_x = 125.486$ in [Moment of Inertia about X-Axis]
 $I_y = 1.511$ in [Moment of Inertia about Y-Axis]
 $A = 1.79$ in²
 $r_x = 8.38$ in
 $r_y = 0.919$ in
 $r_{min} = 0.919$ in

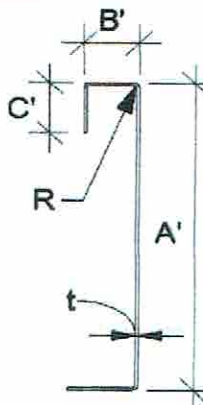

Axial Compression

$P_u = 2.736$ k (Max Axial Comp) $\Omega_c = 1.80$
 $P_n/\Omega_c = 36.854$ k
 $F_e = 70.22$ ksi
 $\lambda_c = 0.84$
 $F_n = 37.11$ ksi
 $L_y = 74$ in
 $k_y L_y/r_y = 64$
Lateral unbraced length
[assume $k=0.8$]

Compression Check = **O.K.**

Check Web Crippling

$h = 24$ in -- Check limits: $C = 4.00$
 $t = 0.0566$ in $h/t = 424.03 \leq 200$ $C_R = 0.14$
 $N = 7.00$ $N/t = 123.67 \leq 210$ $C_N = 0.35$
 $\Omega_w = 1.75$ $N/h = 0.291667 \leq 2.0$ $C_h = 0.02$
 $P_n = 1.366$ k $R/t = 1.50 \leq 9.0$
 $P_u/\Omega_w = 0.780$ k
Long side: $P_{u,trans} = 0.955$ k web stiffener REQ'D # clips = 3
Short side: $P_{u,Long} = 1.213$ k web stiffener REQ'D # clips = 2
*** $h/t > 200$; use web stiffeners

Check Web Stiffener

16Ga x 3/4" x 7" [C-channel]
width of stiffener = 7.000 in $t_s = 0.0566$ 16 Gauge
web of stiff. $w = 6.717$ in $R_s = 0.0849$ in
***Check $w/t_s \leq 1.28\sqrt{E/F_y}$ $\Omega_c = 1.70$
 $w/t_s = 118.675$
 $1.28\sqrt{E/F_y} = 31.091 \rightarrow w/t_s$ over limit Use C3.7.2
 $P_n = 0.7(P_{wc} + A_e F_y) \geq P_{wc}$
 $P_{wc} = 1.366$ k $A_e = 0.380$ in²
 $P_n = 14.262$ k $P_n/\Omega = 8.390$ k
O.K.

Corner Connections

1/4" ϕ SAE Grade 8 bolts w/ 1/4"-20-UNC Threaded inserts
 $T_{crnmax} = 1368$ lbs $\text{Max}(F_{pmASD}/4 \text{ -OR- } F_{hASDtrans}/4 \text{ corner connections})$
 $V_{crnmax} = 1088$ lbs (Max Ten/2 corner connections per side)
Bolt: $T_{all} = 2480$ lbs $V_{all} = 1096$ lbs
Threaded Insert: $T_{all} = 2860$ lbs $V_{all} = 1714$ lbs
of Bolts required for Tension = 0.6
of Bolts required for Shear = 1.0
of Bolts Used = 1.0
***if combined fails: USE $\rightarrow 2.0$
Check Combined Stress in Bolts & Inserts: 1.545 **N.G.** StressComb = 0.772 **O.K.**

Check 1/8" welded connection

Assume $L/t > 25$: $25 \cdot t = 1.415$ in $\Omega = 2.35$
 $L_{req'd} = 0.927$ in $P_n/\Omega = \frac{1}{\Omega} 0.75 t L F_u \geq V_{req}$ $L_{req'd} = \frac{V_{req} \Omega}{0.75 t F_u}$



Connection Unit to Curb Clip

#12 SMS screw

$\Omega = 3.0$

$t_1 = 0.0566$ in

$F_u1 = 65$ ksi

$t_2 = 0.1017$ in (unit base rail thickness)

$F_u2 = 65$ ksi

$d = 0.216$ in (screw diameter)

$dw = 0.375$ in (nom. washer diameter)

$t_2/t_1 = 1.8$

For $t_2/t_1 \leq 1.0$:

Shear: $P_{ns} = 4.2F_{u2}\sqrt{t_2^3d}$

$P_{ns} = 2146$ #

For $t_2/t_1 \geq 2.5$:

$P_{ns} = 2146$ #

$P_{ns} = 2.7t_1dF_{u1}$

$P_{ns} = 2.7t_1dF_{u1}$

$P_{ns} = 2.7t_2dF_{u2}$

$P_{ns} = 2.7t_2dF_{u2}$

$P_{ns}/\Omega = 715$ # <- Controls

$P_{ss}/\Omega = 840$ #

Tension: $P_{not} = 1.214$ k (screw pull-out strength)

$P_{not} = 0.85t_c d F_{u2}$

$P_{nov} = 2.069$ k (screw pull-over strength)

$t_c = \min(t_1, t_2)$

$P_{ts}/\Omega = 405$ # <- Controls

$P_{nov} = 1.5t_1 d_w F_{u1}$

$P_{ts}/\Omega = 845$ #

(full tensile screw capacity)

	Shear (k)	# clips	V_{clip} (k)	V_{allow} (lb)	# screws	spacing
Long side:	5.472	3	1.82	715 #	3	3.00 in
Short side:	5.472	2	2.74	715 #	4	2.00 in

clip width (in) = 7.00

clip height = 1.4 in

min spacing = 0.65 in

edge distance = 0.5 in (min. 1.5d)

Check Block shear rupture: O.K.

thinnest part = 0.0566 AISI BSR applies

$F_y = 50$ ksi

$\Omega = 2.22$ bolt/screw connection

$A_{gv} = 0.368$ in²

$A_{nv} = 0.325$ in²


$A_{nt} = 0.033$ in²

$R_n/\Omega = 5.932$ k

$R_n = 0.6F_y A_{gv} + F_u A_{nt} \leq 0.6F_u A_{nv} + F_u A_{nt}$

(AISI Sect. E5.3)

BSR O.K.

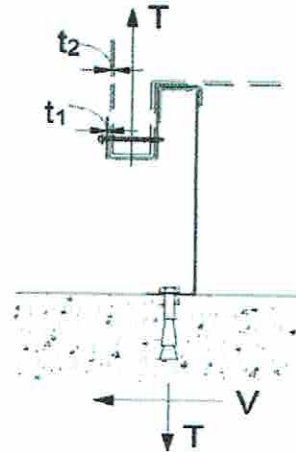

Connection of Curb to Supporting Structure

Roof Loading: SEISMIC: $(0.6-0.14SDS)D + 0.7E$

WIND: $0.6D + W$

Transverse:	Uplift _{MAX}	4454 lbs	Shear _{MAX}	3207 lbs
Compression _{SEISMIC}	5259 lbs	$= [F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.145_{DS}) * (WGT_{unit+curb}/2) * w_{curb}] / w_{curb}$		
Tension _{SEISMIC}	4454 lbs	$= Comp_{SEISMIC} - (0.6 - 0.145_{DS}) * (WGT_{unit+curb})$		
Compression _{WIND}	915 lbs	$= [F_{htransASD} * (H_{cm} + H_{curb}) + 0.6 * (WGT_{unit+curb}/2) * w_{curb} - F_{vertASD} * w_{curb}/2] / w_{curb}$		
Tension _{WIND}	1811 lbs	$= [F_{htransASD} * (H_{cm} + H_{curb}) - 0.6 * (WGT_{unit+curb}/2) * w_{curb} + F_{vertASD} * w_{curb}/2] / w_{curb}$		
Longitudinal:	Uplift _{MAX}	3433 lbs	Shear _{MAX}	3207 lbs
Compression _{SEISMIC}	4238 lbs	$= [F_{pmaxASD} * (H_{cm} + H_{curb}) + (1 + 0.145_{DS}) * (WGT_{unit+curb}/2) * L_{curb}] / L_{curb}$		
Tension _{SEISMIC}	3433 lbs	$= Comp_{SEISMIC} - (0.6 - 0.145_{DS}) * (WGT_{unit+curb})$		
Compression _{WIND}	280 lbs	$= [F_{htransASD} * (H_{cm} + H_{curb}) + 0.6 * (WGT_{unit+curb}/2) * L_{curb} - F_{vertASD} * L_{curb}/2] / L_{curb}$		
Tension _{WIND}	1175 lbs	$= [F_{htransASD} * (H_{cm} + H_{curb}) - 0.6 * (WGT_{unit+curb}/2) * L_{curb} + F_{vertASD} * L_{curb}/2] / L_{curb}$		

Wood Attachment:

Use 5/8" ϕ wood lag screws

w/ 3.5" Min. Embed

Transverse:	Tall _{metal} = 946.67 lbs	Vall _{metal} = 1043.33 lbs
	Tall _{wood} = 1195.95 lbs	Vall _{wood} = 1024 lbs
# of Screws Req'd for Uplift =	4.70	COMBINED LOADING: 0.979 O.K.
# of Screws Req'd for Shear =	3.13	Screw Spacing = 17.7 in o.c.
Total # of screws Required =	7	

Use 5/8" ϕ wood lag screws @ 17.7 in o.c. along long side of curb

Longitudinal:

# of Screws Req'd for Uplift =	3.6	COMBINED LOADING: 0.857 O.K.
# of Screws Req'd for Shear =	3.1	Screw Spacing = 12.5 in o.c.
Total # of screws Required =	7	

Use 5/8" ϕ wood lag screws @ 12.5 in o.c. along short side of curb

Steel Deck Attachment:

Use 5/8" ϕ A307 Bolts attached to steel angle below deck

Transverse:	Tall _{bolt} = 6903 lbs	Vall _{bolt} = 3682 lbs
	6903 lbs	3682 lbs
# of Bolts Req'd for Uplift =	0.65	COMBINED LOADING: 0.402 O.K.
# of Bolts Req'd for Shear =	0.87	Bolt Spacing = 102.3 in o.c.
Total # of Bolts Required =	2	

Use 5/8" ϕ A307 Bolts attached to steel angle below deck @ 102.3 in o.c. along long side of curb

Longitudinal:

# of Bolts Req'd for Uplift =	0.50	COMBINED LOADING: 0.349 O.K.
# of Bolts Req'd for Shear =	0.87	Req'd Min Spacing = 71.0 in o.c.
Total # of Bolts Required =	2	

Use 5/8" ϕ A307 Bolts attached to steel angle below deck @ 71 in o.c. along short side of curb



MOUR GROUP

ENGINEERING + DESIGN

6593 Riverdale St.
San Diego, CA 92120
(619)727-4800

Page ___ of ___

For Concrete anchorage: SEISMIC $(0.6-0.14S_{DS})D + 0.7Q_D E$ ($Q_D = 2.5$)

Concrete Attachment: 3/4" ϕ Hilti Hit-HY 200 adhesive anchors w/ 4" embed

$$T_{all,LRFD} = 1722 \text{ lbs}$$

$$V_{all,LRFD} = 2032 \text{ lbs}$$

$$\alpha = (1 + 0.2S_{DS})D + 2.5E = 1.87$$

$$T_{all,ASD} = T_{all,LRFD}/\alpha = 920.9 \text{ lbs}$$

$$V_{all,ASD} = V_{all,LRFD}/\alpha = 1086.6 \text{ lbs}$$

$$(D = 0.465, E = 0.535)$$

Transverse: Uplift_{MAX} = 10053 lbs Shear_{MAX} = 8017 lbs

$$\text{Compression}_{SEISMIC} = 10859 \text{ lbs} = [2.5 \cdot F_{pmaxASD} \cdot (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) \cdot (WGT_{unit+curb}/2) \cdot w_{curb}] / w_{curb}$$

$$\text{Tension}_{SEISMIC} = 10053 \text{ lbs} = \text{Comp}_{SEISMIC} - (0.6 - 0.14S_{DS}) \cdot (WGT_{unit+curb})$$

$$\text{Shear}_{SEISMIC} = 8017 \text{ lbs} = 2.5 \cdot F_{pmaxASD} / 2$$

$$\text{Min Bolts Req'd Uplift} = 10.92 \text{ spacing} = 9.03 \text{ in o.c.} \quad T_{applied} = 628.3 \text{ lbs}$$

$$\text{Min Bolts Req'd Shear} = 7.38 \text{ spacing} = 12.89286 \text{ in o.c.} \quad V_{applied} = 501.0 \text{ lbs}$$

Try using 16 bolts
spaced at 6.82 in o.c.

$$\text{COMBINED LOADING} = \frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 1.14$$

Use 16 - 3/4" ϕ Hilti Hit-HY 200 adhesive anchors @ 6.8 in o.c. max. along long side of curb w/ 4" embed

Longitudinal: Uplift_{MAX} = 7501 lbs Shear_{MAX} = 8017 lbs

$$\text{Compression}_{SEISMIC} = 8306 \text{ lbs} = [2.5 \cdot F_{pmaxASD} \cdot (H_{cm} + H_{curb}) + (1 + 0.14S_{DS}) \cdot (WGT_{unit+curb}/2) \cdot L_{curb}] / L_{curb}$$

$$\text{Tension}_{SEISMIC} = 7501 \text{ lbs} = \text{Comp}_{SEISMIC} - (0.6 - 0.14S_{DS}) \cdot (WGT_{unit+curb})$$

$$\text{Shear}_{SEISMIC} = 8017 \text{ lbs} = 2.5 \cdot F_{pmaxASD} / 2$$

$$\text{Min Bolts Req'd Uplift} = 8.15 \text{ spacing} = 7.375 \text{ in o.c.} \quad T_{applied} = 577.0 \text{ lbs}$$

$$\text{Min Bolts Req'd Shear} = 7.38 \text{ spacing} = 8.428571 \text{ in o.c.} \quad V_{applied} = 616.7 \text{ lbs}$$

Try using 13 bolts
spaced at 5.92 in o.c.

$$\text{COMBINED LOADING} = \frac{T_{applied}}{T_{allow,ASD}} + \frac{V_{applied}}{V_{allow,ASD}} \leq 1.2 = 1.19$$

Use 13 - 3/4" ϕ Hilti Hit-HY 200 adhesive anchors @ 5.9 in o.c. max. along short side of curb w/ 4" embed

CURB DESIGN SUMMARY: CBWC-114			
CURB RAIL THICKNESS: 0.0566 in 16 Gauge			
UNIT CLIP THICKNESS: 0.0566 in 16 Gauge			
# OF CLIPS (LONG SIDE) - 3 clips with 3 - #12 SMS screws each clip			
WEB STIFFENER: 16Ga x 3/4" x 7" (C-channel) stiffener at each clip			
# OF CLIPS (SHORT SIDE) - 2 clips with 4 - #12 SMS screws each clip			
WEB STIFFENER: 16Ga x 3/4" x 7" (C-channel) stiffener at each clip			
CORNER CONNECTION: Use 2 - 1/4" ϕ SAE Grade 8 bolts w/ 1/4-20-UNC Threaded inserts			
CURB ANCHORAGE	WOOD	STEEL	CONCRETE
	5/8" ϕ lag screw w/ min. 3.5" embed (SGmin=0.43)	5/8" ϕ A307 bolts	3/4" ϕ thrd'd rod in Hilti HIT-HY 200 epoxy, min. 4" embed
LONG DIRECTION	7 @ 17.71 in o.c.	2 @ 102.25 in o.c.	16 @ 6.82 in o.c.
SHORT DIRECTION	7 @ 12.5 in o.c.	2 @ 71 in o.c.	13 @ 5.92 in o.c.